




SOUND ABSORPTION AREA FOR OBJECT

Measured and evaluated according to ISO 354 and ISO 20189

| | | | |
|-------------------|----------------------------|----------|--------|
| Client: | Boom Interior | | |
| Object: | Xrozz Absorption Ovan Bord | | |
| Size [mm]: | w = 450 | h = 1200 | d = 40 |

| Octave band (Hz) | Equivalent sound absorption area / unit (m ² Sabine) |
|------------------------------|---|
| 63 | 0.15 |
| 125 | 0.23 |
| 250 | 0.38 |
| 500 | 0.47 |
| 1000 | 0.55 |
| 2000 | 0.67 |
| 4000 | 0.85 |
| N₁₀ = 21.3 | |

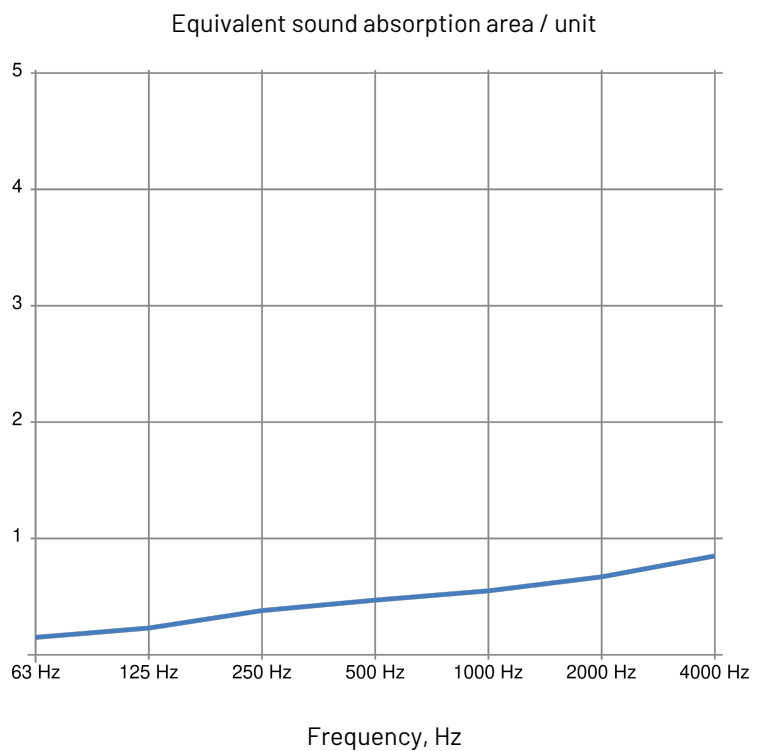

| ORIGINAL TEST REPORTS | DATE OF REPORT |
|-----------------------------------|----------------|
| Akustikverkstan report 18-701-M1a | 2018-08-23 |
| Akustikverkstan report 20-240-M1 | 2020-06-24 |

The presented results are interpolated using the method described in ISO 20189 from the original test reports.

