




SOUND ABSORPTION AREA FOR OBJECT

Measured and evaluated according to ISO 354 and ISO 20189

Client:	Boom Interior		
Object:	Xrozz Absorption Ovan Bord		
Size [mm]:	w = 450	h = 1400	d = 40

Octave band (Hz)	Equivalent sound absorption area / unit (m ² Sabine)
63	0.18
125	0.29
250	0.44
500	0.54
1000	0.63
2000	0.78
4000	0.98
N₁₀ = 18.5	

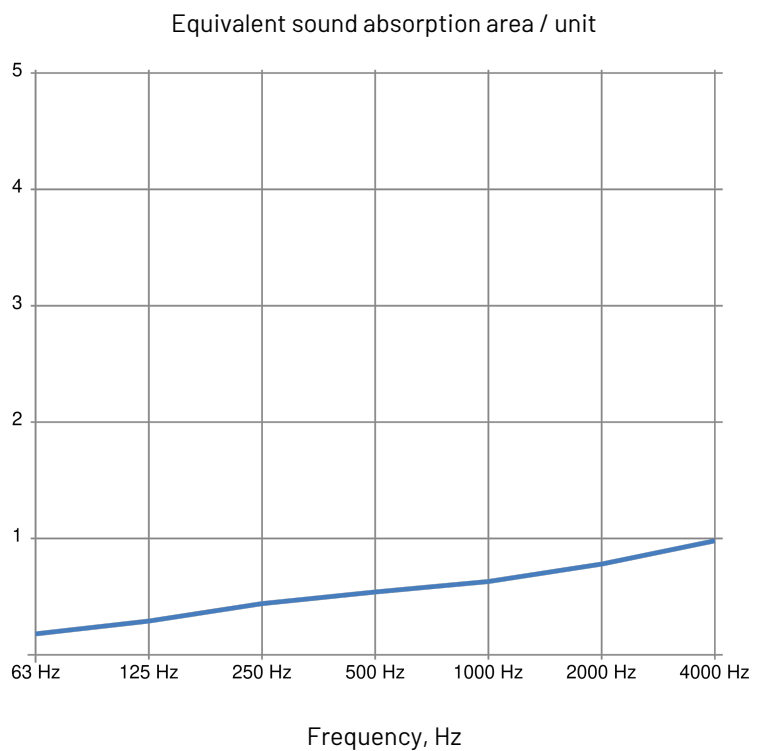

ORIGINAL TEST REPORTS	DATE OF REPORT
Akustikverkstan report 18-701-M1a	2018-08-23
Akustikverkstan report 20-240-M1	2020-06-24

The presented results are interpolated using the method described in ISO 20189 from the original test reports.

