




SOUND ABSORPTION AREA FOR OBJECT

Measured and evaluated according to ISO 354 and ISO 20189

Client:	Boom Interior		
Object:	Xrozz Absorption Ovan Bord		
Size [mm]:	w = 450	h = 1600	d = 40

Octave band (Hz)	Equivalent sound absorption area / unit (m ² Sabine)
63	0.22
125	0.34
250	0.5
500	0.61
1000	0.71
2000	0.89
4000	1.12
N₁₀ = 16.4	

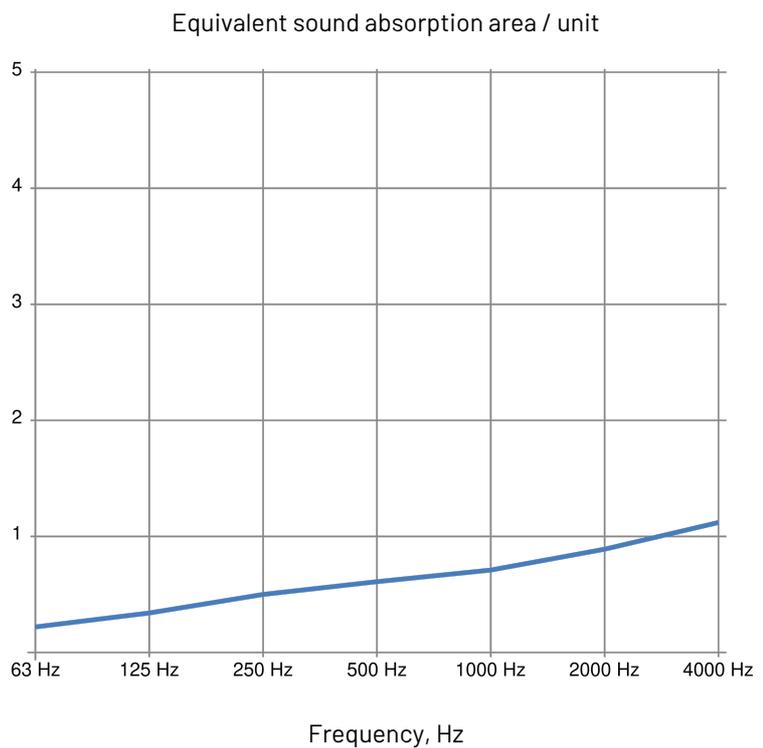

ORIGINAL TEST REPORTS	DATE OF REPORT
Akustikverkstan report 20-240-M1	2020-06-24
Akustikverkstan report 20-240-M2	2020-06-24

The presented results are interpolated using the method described in ISO 20189 from the original test reports.

