




SOUND ABSORPTION AREA FOR OBJECT

Measured and evaluated according to ISO 354 and ISO 20189

Client:	Götessons/ Gotessons		
Object:	ScreenIT A30 Floor Screen		
Size [mm]:	w = 2000	h = 450	d = 40

Octave band (Hz)	Equivalent sound absorption area / unit (m ² Sabine)
63	0.27
125	0.52
250	0.84
500	1
1000	1.1
2000	1.3
4000	1.4
N ₁₀ = 10	

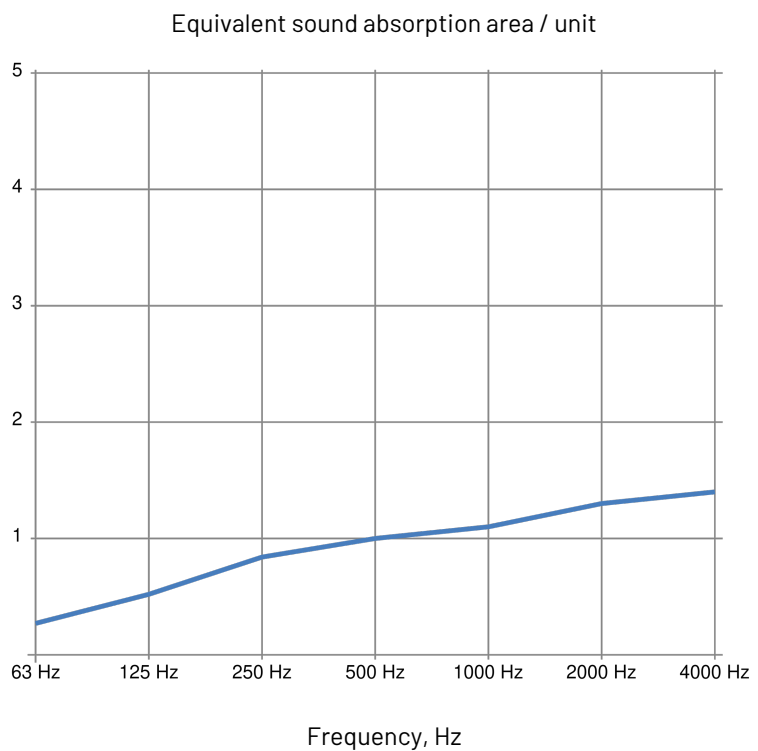

ORIGINAL TEST REPORT	DATE OF REPORT
Akustikverkstan report 2629-R4-M8	2023-03-22

