




# SOUND ABSORPTION AREA FOR OBJECT

Measured and evaluated according to ISO 354 and ISO 20189

<b>Client:</b>	Götessons/ Gotessons		
<b>Object:</b>	ScreenIT A30 Floor Screen		
<b>Size [mm]:</b>	w = 1000	h = 650	d = 40

Octave band (Hz)	Equivalent sound absorption area / unit (m <sup>2</sup> Sabine)
63	0.15
125	0.28
250	0.54
500	0.63
1000	0.79
2000	0.89
4000	1
<b>N<sub>10</sub> = 15.9</b>	

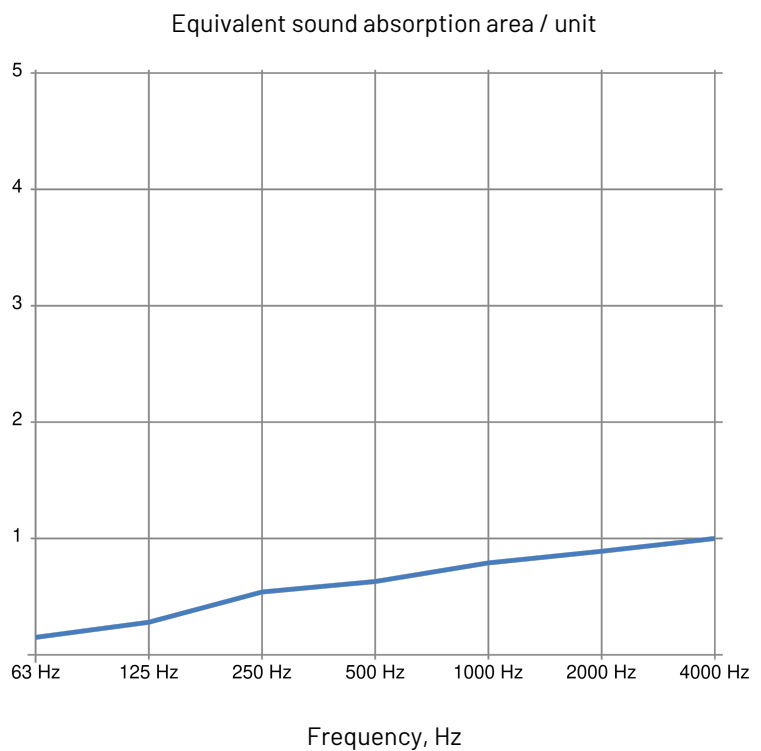

<b>ORIGINAL TEST REPORT</b>	<b>DATE OF REPORT</b>
Akustikverkstan report 2629-R4-M5	2023-03-22

