




SOUND ABSORPTION AREA FOR OBJECT

Measured and evaluated according to ISO 354 and ISO 20189

Client:	Götessons/ Gotessons		
Object:	ScreenIT A30 Floor Screen		
Size [mm]:	w = 1200	h = 650	d = 40

Octave band (Hz)	Equivalent sound absorption area / unit (m ² Sabine)
63	0.21
125	0.39
250	0.7
500	0.8
1000	0.96
2000	1.1
4000	1.2
N ₁₀ = 12.5	

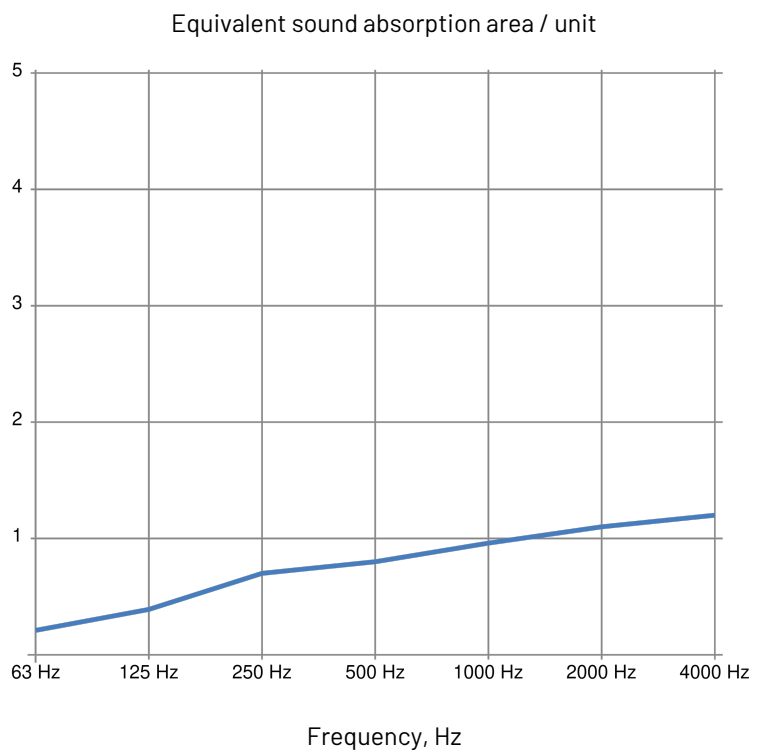

ORIGINAL TEST REPORT	DATE OF REPORT
Akustikverkstan report 2629-R4-M6	2023-03-22

