




# SOUND ABSORPTION AREA FOR OBJECT

Measured and evaluated according to ISO 354 and ISO 20189

<b>Client:</b>	Götessons/ Gotessons		
<b>Object:</b>	ScreenIT A30 Floor Screen		
<b>Size [mm]:</b>	w = 1200	h = 800	d = 40

Octave band (Hz)	Equivalent sound absorption area / unit (m <sup>2</sup> Sabine)
63	0.3
125	0.58
250	0.91
500	1.1
1000	1.2
2000	1.4
4000	1.5
<b>N<sub>10</sub> = 9.1</b>	

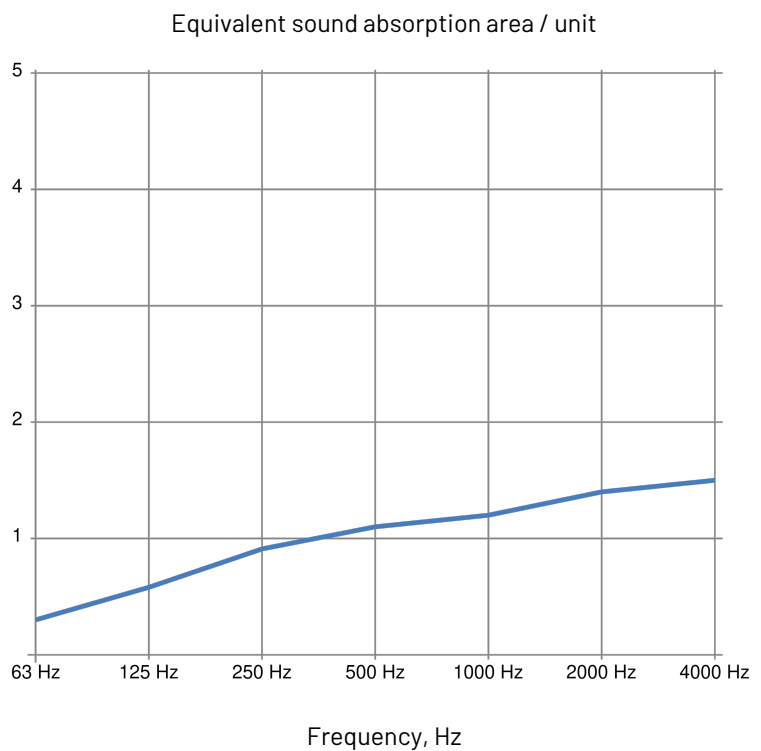

<b>ORIGINAL TEST REPORT</b>	<b>DATE OF REPORT</b>
Akustikverkstan report 2629-R4-M10	2023-03-22

