




# SOUND ABSORPTION AREA FOR OBJECT

Measured and evaluated according to ISO 354 and ISO 20189

<b>Client:</b>	Götessons/ Gotessons		
<b>Object:</b>	ScreenIT A30 Floor Screen		
<b>Size [mm]:</b>	w = 1400	h = 800	d = 40

Octave band (Hz)	Equivalent sound absorption area / unit (m <sup>2</sup> Sabine)
63	0.25
125	0.47
250	0.96
500	1.3
1000	1.5
2000	1.8
4000	2.1
<b>N<sub>10</sub> = 7.7</b>	

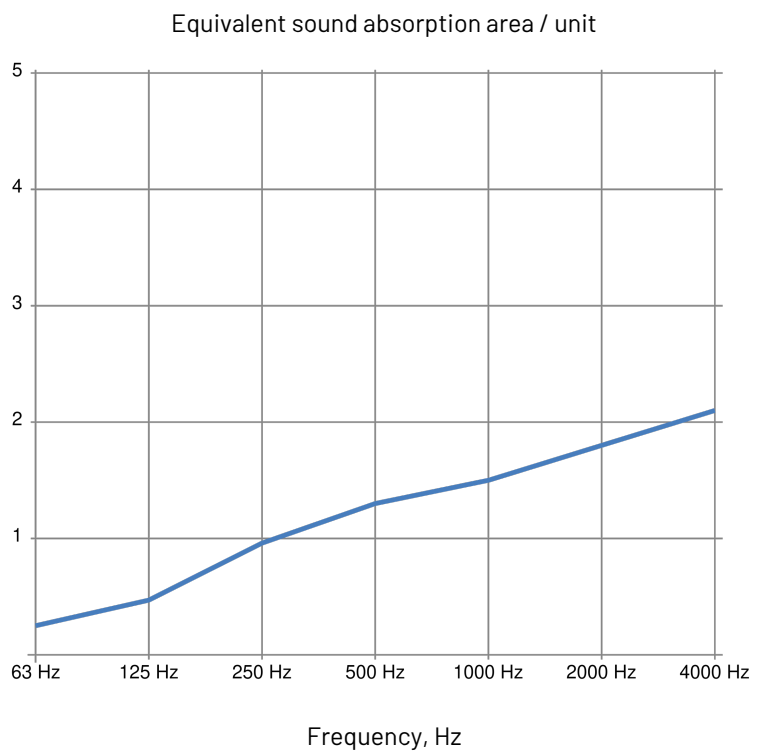

<b>ORIGINAL TEST REPORT</b>	<b>DATE OF REPORT</b>
Akustikverkstan report 2629-R4-M11	2023-03-22

