




SOUND ABSORPTION AREA FOR OBJECT

Measured and evaluated according to ISO 354 and ISO 20189

Client:	Götessons/ Gotessons		
Object:	ScreenIT A30 Floor Screen		
Size [mm]:	w = 1600	h = 800	d = 40

Octave band (Hz)	Equivalent sound absorption area / unit (m ² Sabine)
63	0.2
125	0.38
250	1
500	1.4
1000	1.8
2000	2.1
4000	2.5
N₁₀ = 7.1	

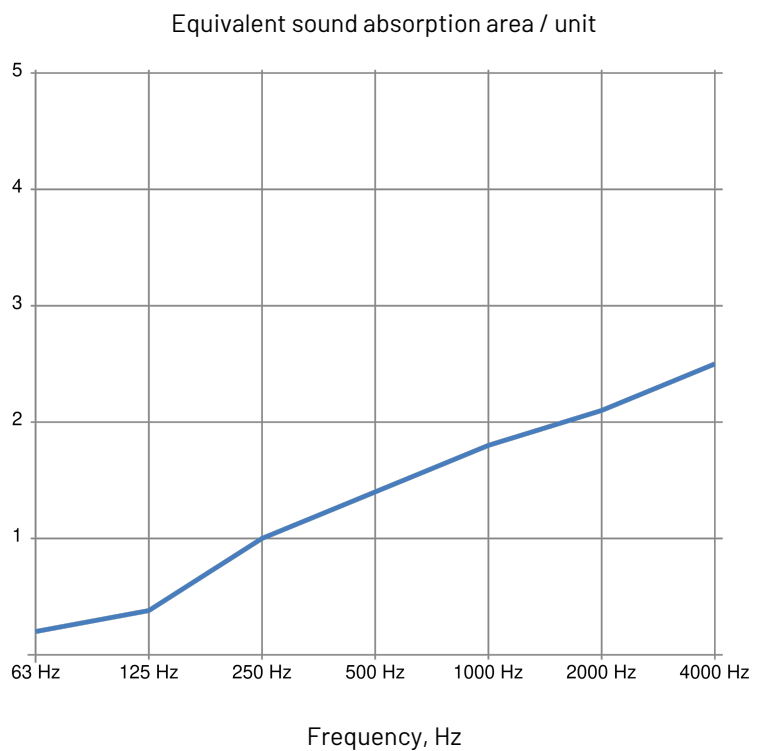

ORIGINAL TEST REPORT	DATE OF REPORT
Akustikverkstan report 2629-R4-M13	2023-03-22

