




SOUND ABSORPTION AREA FOR OBJECT

Measured and evaluated according to ISO 354 and ISO 20189

Client:	Götessons/ Gotessons		
Object:	ScreenIT A30 Floor Screen		
Size [mm]:	w = 1400	h = 1400	d = 40

Octave band (Hz)	Equivalent sound absorption area / unit (m ² Sabine)
63	0.46
125	0.65
250	1.4
500	2
1000	2.5
2000	2.8
4000	2.9
N₁₀ = 5	

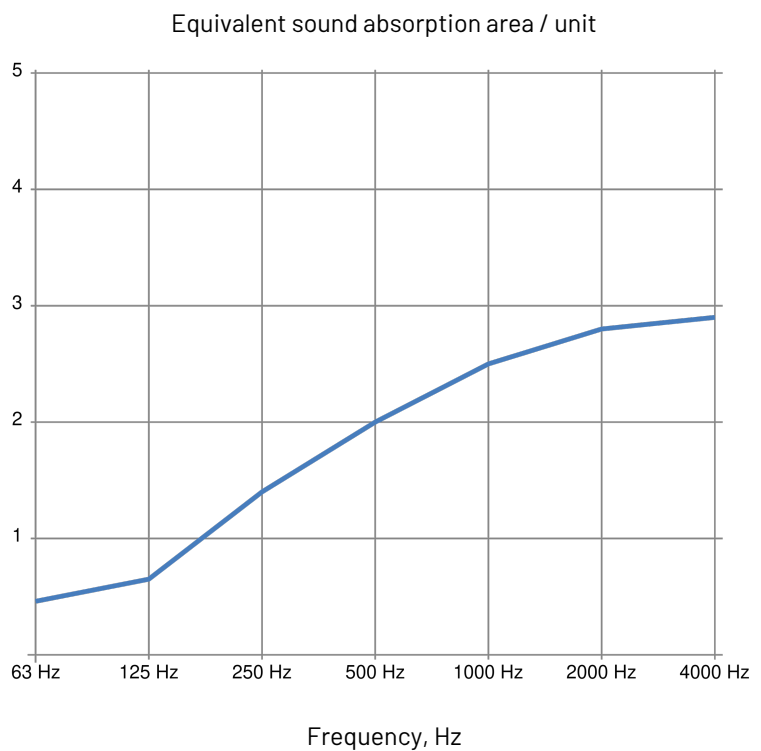

ORIGINAL TEST REPORT	DATE OF REPORT
Akustikverkstan report 2629-R4-M19	2023-03-22

