




SOUND ABSORPTION AREA FOR OBJECT

Measured and evaluated according to ISO 354 and ISO 20189

Client:	Götessons/ Gotessons		
Object:	ScreenIT A30 Floor Screen		
Size [mm]:	w = 1000	h = 1600	d = 40

Octave band (Hz)	Equivalent sound absorption area / unit (m ² Sabine)
63	0.28
125	0.48
250	1.2
500	1.6
1000	2.1
2000	2.5
4000	2.7
N₁₀ = 6.3	

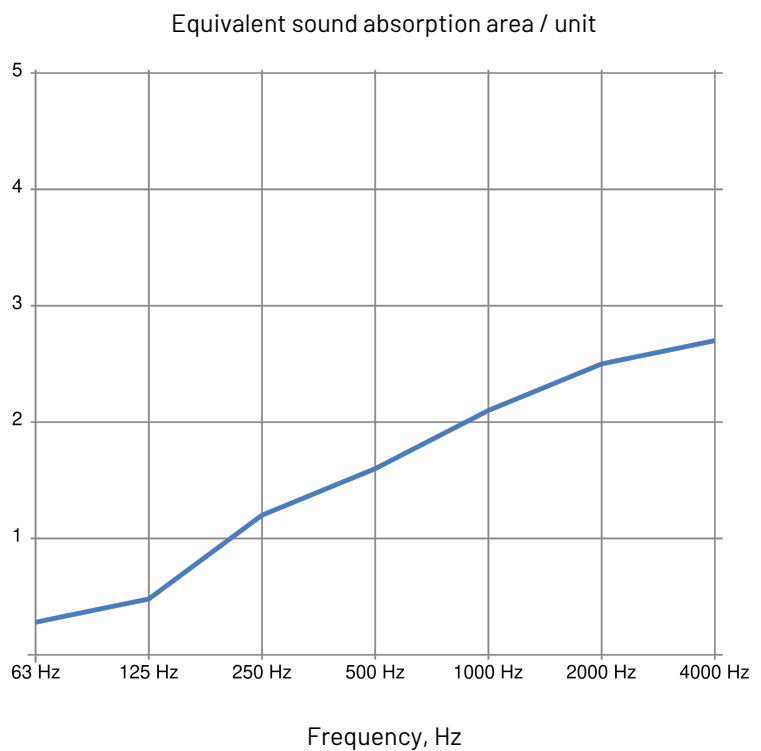

ORIGINAL TEST REPORT	DATE OF REPORT
Akustikverkstan report 2629-R4-M17	2023-03-22

