




SOUND ABSORPTION AREA FOR OBJECT

Measured and evaluated according to ISO 354 and ISO 20189

Client:	Götessons/ Gotessons		
Object:	ScreenIT A30 Floor Screen		
Size [mm]:	w = 1400	h = 1800	d = 40

Octave band (Hz)	Equivalent sound absorption area / unit (m ² Sabine)
63	0.6
125	0.93
250	1.9
500	2.6
1000	3.1
2000	3.5
4000	3.8
N₁₀ = 3.8	

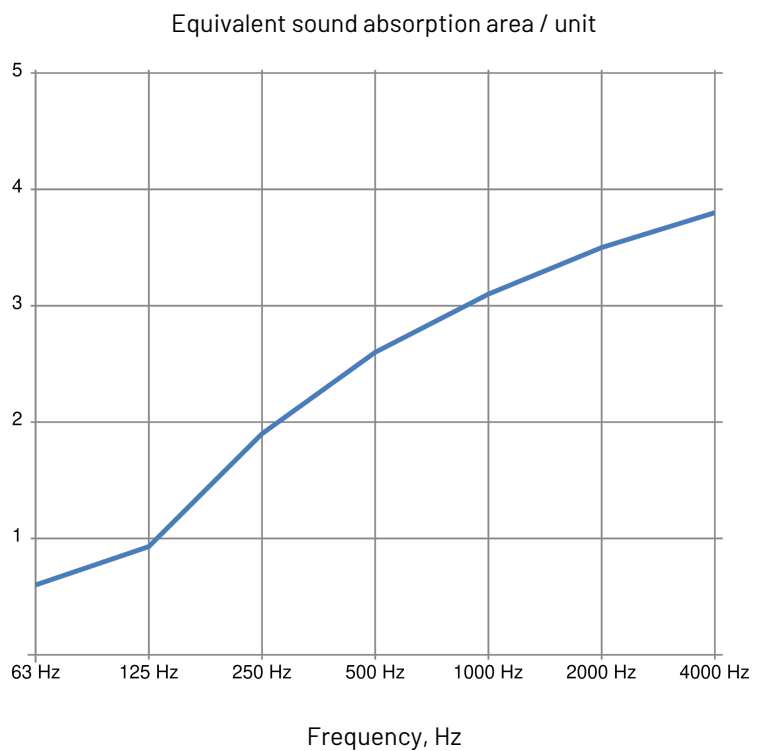

ORIGINAL TEST REPORT	DATE OF REPORT
Akustikverkstan report 2629-R4-M21	2023-03-22

