




SOUND ABSORPTION AREA FOR OBJECT

Measured and evaluated according to ISO 354 and ISO 20189

| | | | |
|-------------------|--|---------|---------|
| Client: | Abstracta | | |
| Object: | Holly lighting, vertical (corner position) | | |
| Size [mm]: | w = 883 | h = 585 | d = 540 |

| Octave band (Hz) | Equivalent sound absorption area / unit (m ² Sabine) |
|------------------------------|---|
| 63 | 0 |
| 125 | 0.42 |
| 250 | 0.64 |
| 500 | 0.84 |
| 1000 | 0.67 |
| 2000 | 0.73 |
| 4000 | 0.82 |
| N₁₀ = 14.9 | |

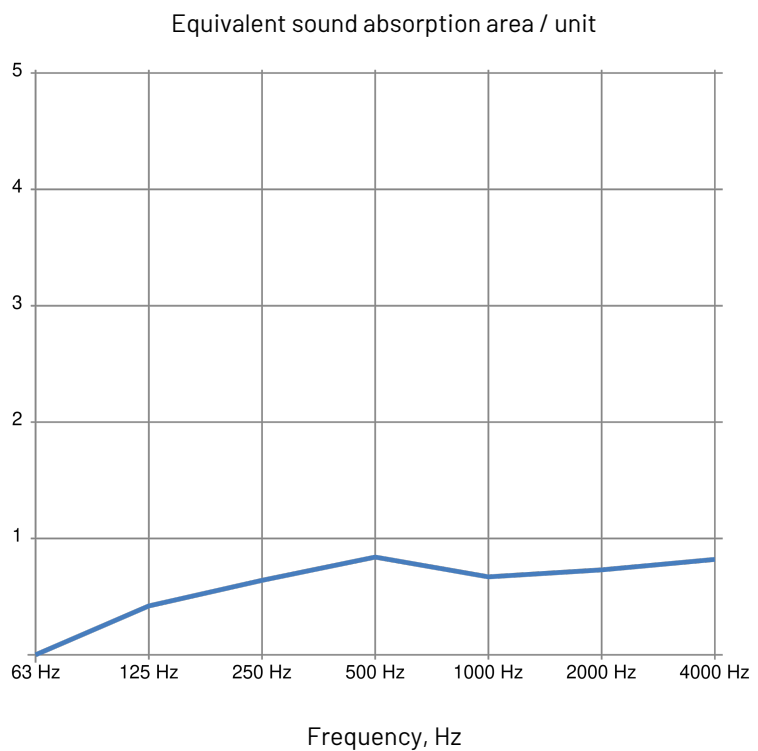

| | |
|-----------------------------|-----------------------|
| ORIGINAL TEST REPORT | DATE OF REPORT |
| 20220608.1 | 2023-04-20 |

