




SOUND ABSORPTION AREA FOR OBJECT

Measured and evaluated according to ISO 354 and ISO 20189

| | | | |
|-------------------|--|---------|--------|
| Client: | Abstracta | | |
| Object: | Basic Baffle (Parallel, 25 cm distance in between) | | |
| Size [mm]: | w = 2000 | h = 650 | d = 30 |

| Octave band (Hz) | Equivalent sound absorption area / unit (m ² Sabine) |
|-----------------------------|---|
| 63 | 0 |
| 125 | 0.49 |
| 250 | 0.7 |
| 500 | 1.03 |
| 1000 | 1.36 |
| 2000 | 1.51 |
| 4000 | 1.34 |
| N₁₀ = 9.7 | |

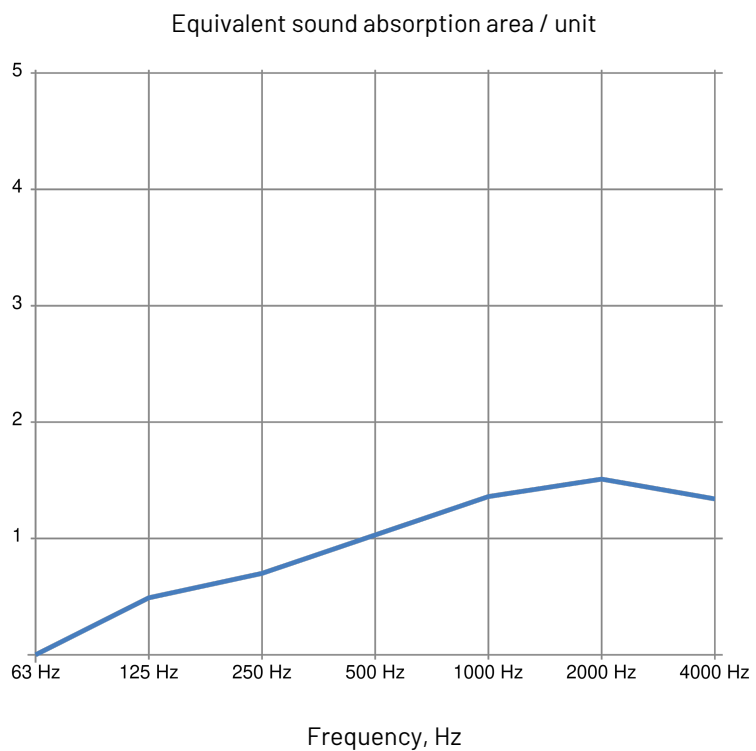

| | |
|-----------------------------|-----------------------|
| ORIGINAL TEST REPORT | DATE OF REPORT |
| 20210128.3 | 2023-05-09 |

