




SOUND ABSORPTION AREA FOR OBJECT

Measured and evaluated according to ISO 354 and ISO 20189

Client:	Abstracta		
Object:	Bits Wall XL		
Size [mm]:	w = 748	h = 649	d = 100

Octave band (Hz)	Equivalent sound absorption area / unit (m ² Sabine)
63	0
125	0.08
250	0.15
500	0.24
1000	0.28
2000	0.26
4000	0.23
N₁₀ = 43.5	

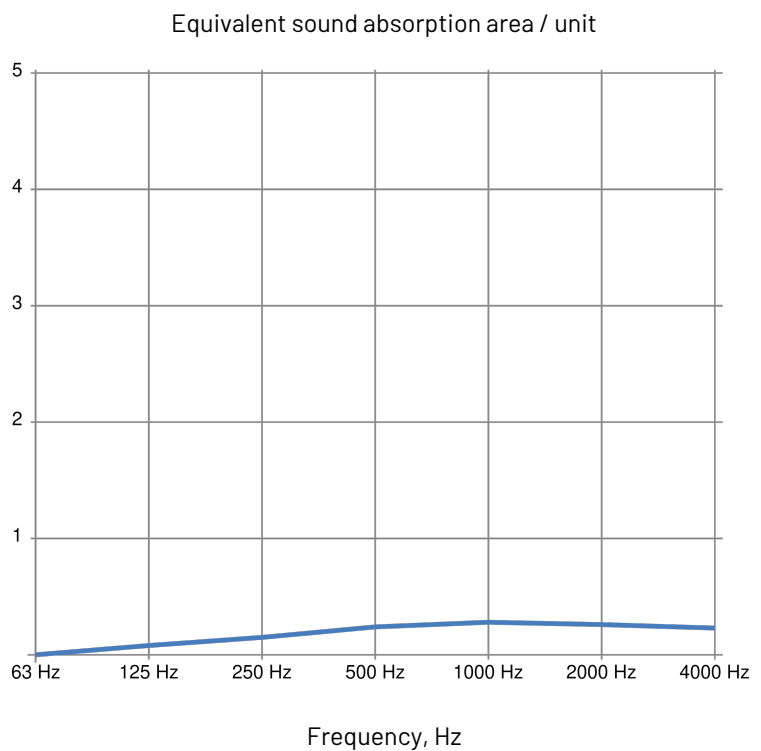

ORIGINAL TEST REPORT	DATE OF REPORT
20200828.2	2023-05-10

