




SOUND ABSORPTION AREA FOR OBJECT

Measured and evaluated according to ISO 354 and ISO 20189

Client:	Abstracta		
Object:	Abstracta x Wall of Art		
Size [mm]:	w = 700	h = 500	d = 40

Octave band (Hz)	Equivalent sound absorption area / unit (m ² Sabine)
63	
125	0.08
250	0.12
500	0.22
1000	0.15
2000	0.12
4000	0.11
N₁₀ = 90.9	

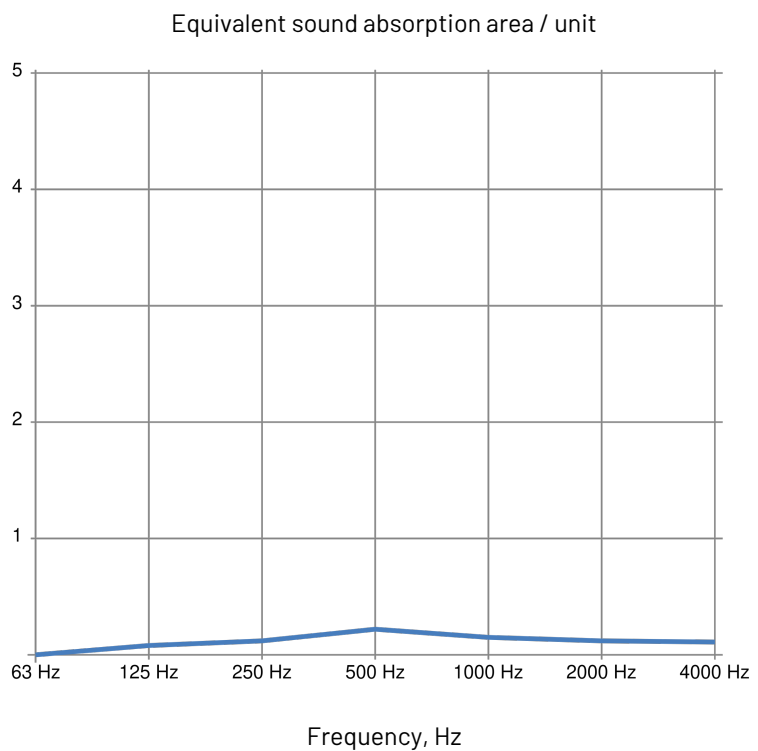

ORIGINAL TEST REPORT	DATE OF REPORT
20230605.1	2023-08-14

