




# SOUND ABSORPTION AREA FOR OBJECT

Measured and evaluated according to ISO 354 and ISO 20189

**Client:** Abstracta  
**Object:** Abstracta x Wall of Art  
**Size [mm]:** w = 1400 h = 1000 d = 40

Octave band (Hz)	Equivalent sound absorption area / unit (m <sup>2</sup> Sabine)
63	
125	0.4
250	0.7
500	1.3
1000	0.9
2000	0.7
4000	0.6
N <sub>10</sub> = 16.7	

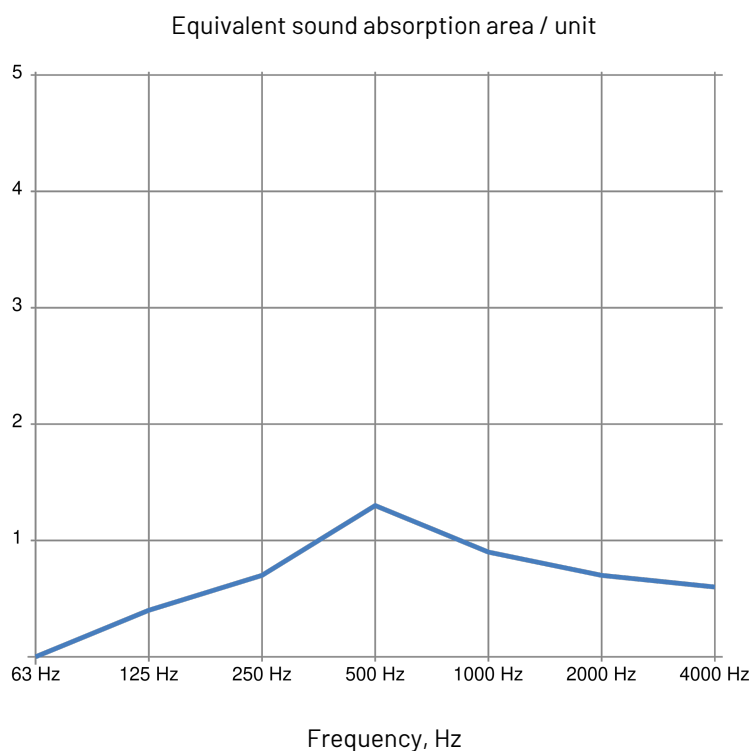

ORIGINAL TEST REPORT

20230605.1

DATE OF REPORT

2023-08-14

