




SOUND ABSORPTION AREA FOR OBJECT

Measured and evaluated according to ISO 354 and ISO 20189

Client:	Abstracta		
Object:	Abstracta x Wall of Art		
Size [mm]:	w = 1400	h = 1000	d = 40

Octave band (Hz)	Equivalent sound absorption area / unit (m ² Sabine)
63	
125	0.4
250	0.7
500	1.3
1000	0.9
2000	0.7
4000	0.6
N₁₀ = 16.7	

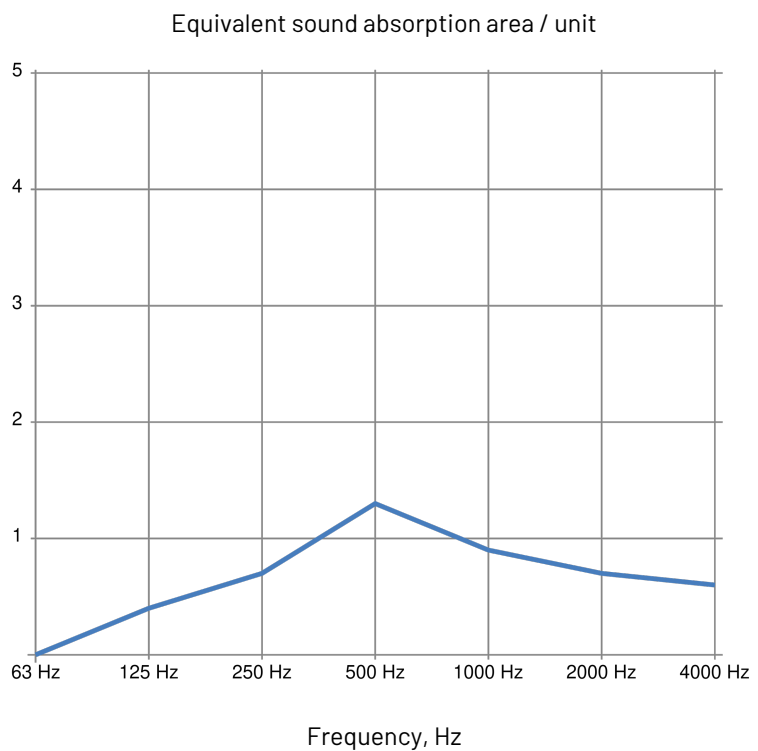

ORIGINAL TEST REPORT	DATE OF REPORT
20230605.1	2023-08-14

