




SOUND ABSORPTION AREA FOR OBJECT

Measured and evaluated according to ISO 354 and ISO 20189

Client:	Abstracta		
Object:	Vika Floor Screen		
Size [mm]:	w = 1180	h = 1540	d = 231

Octave band (Hz)	Equivalent sound absorption area / unit (m ² Sabine)
63	
125	0.12
250	0.45
500	0.91
1000	1.2
2000	1.4
4000	1.51
N₁₀ = 11	

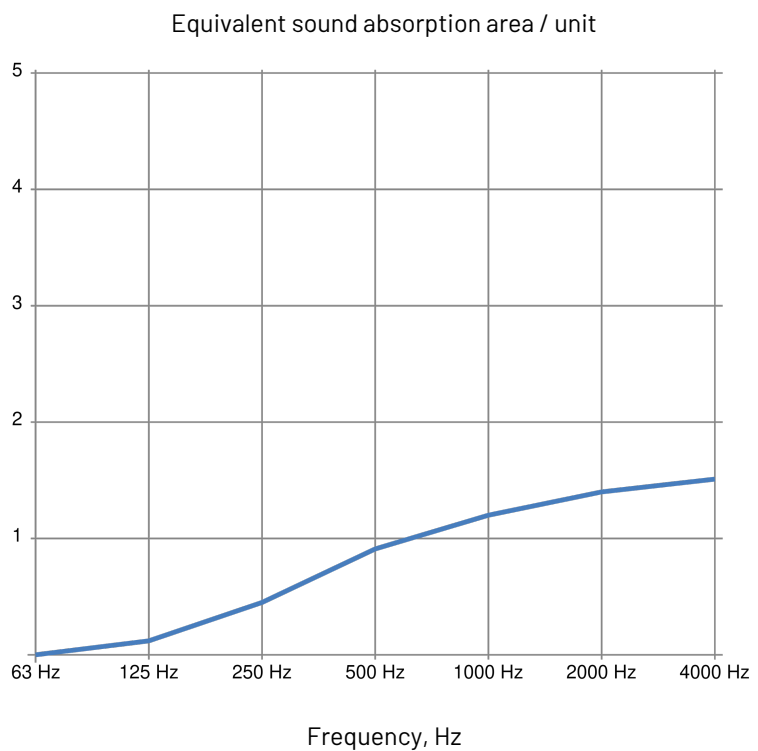

ORIGINAL TEST REPORT	DATE OF REPORT
20231213.1	2023-12-18

