




SOUND ABSORPTION AREA FOR OBJECT

Measured and evaluated according to ISO 354 and ISO 20189

Client:	OFFECCT		
Object:	Soundwave Wall		
Size [mm]:	w = 1170	h = 2340	d = 50

Octave band (Hz)	Equivalent sound absorption area / unit (m ² Sabine)
63	0
125	0.1
250	0.2
500	0.6
1000	1.6
2000	2.5
4000	2.3
N₁₀ = 16.7	

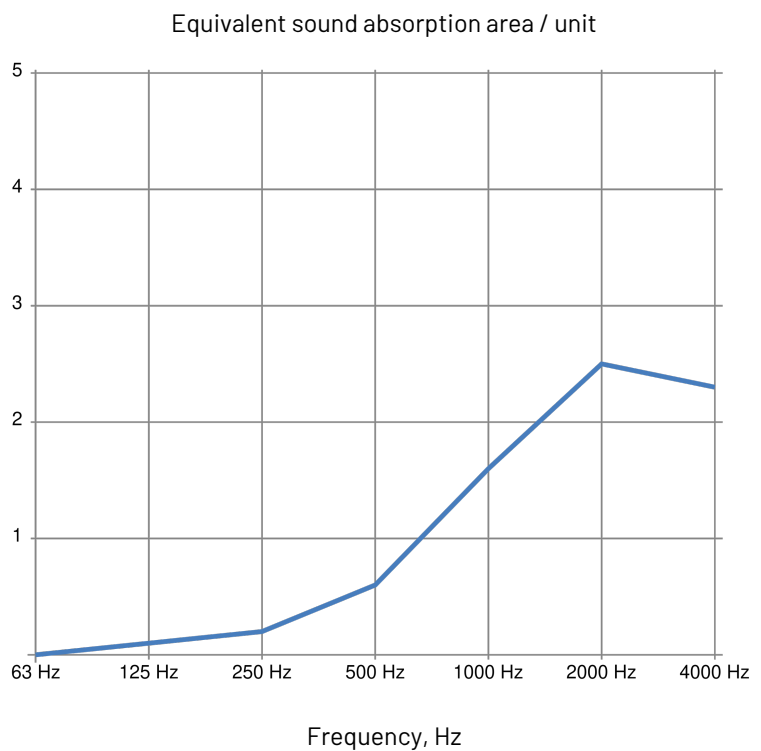

ORIGINAL TEST REPORT	DATE OF TEST
Akustikverkstan report 15-226-M2	2015-11-11

