




# SOUND ABSORPTION AREA FOR OBJECT

Measured and evaluated according to ISO 354 and ISO 20189

<b>Client:</b>	OFFECCT		
<b>Object:</b>	Soundwave Wall		
<b>Size [mm]:</b>	w = 1170	h = 2340	d = 50

Octave band (Hz)	Equivalent sound absorption area / unit (m <sup>2</sup> Sabine)
63	0
125	0.1
250	0.2
500	0.6
1000	1.6
2000	2.5
4000	2.3
<b>N<sub>10</sub> = 16.7</b>	

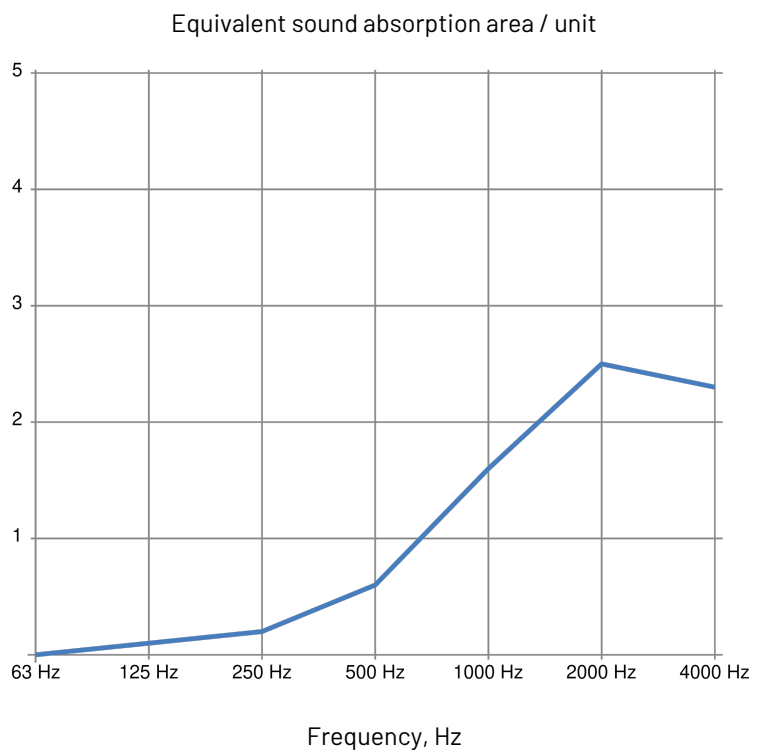

<b>ORIGINAL TEST REPORT</b>	<b>DATE OF TEST</b>
Akustikverkstan report 15-226-M2	2015-11-11

