




SOUND ABSORPTION AREA FOR OBJECT

Measured and evaluated according to ISO 354 and ISO 20189

| | | | |
|-------------------|------------------|----------|--------|
| Client: | Abstracta | | |
| Object: | Bits Wall 30 pcs | | |
| Size [mm]: | w = 2320 | h = 3060 | d = 95 |

| Octave band (Hz) | Equivalent sound absorption area / unit (m ² Sabine) |
|-----------------------------|---|
| 63 | 0 |
| 125 | 1.1 |
| 250 | 2.7 |
| 500 | 4 |
| 1000 | 4.2 |
| 2000 | 4.2 |
| 4000 | 4 |
| N₁₀ = 2.5 | |

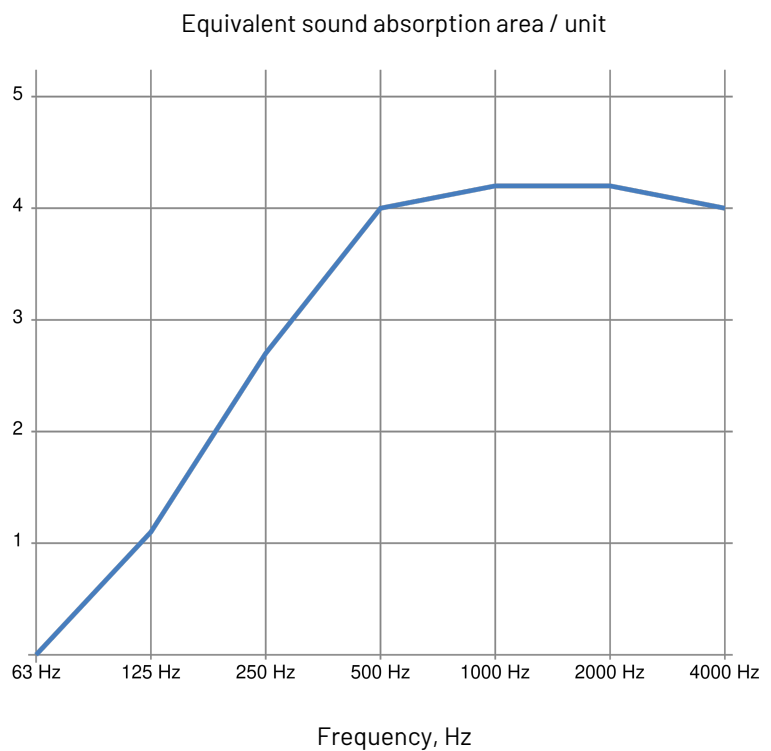

| | |
|----------------------------------|---------------------|
| ORIGINAL TEST REPORT | DATE OF TEST |
| SG-Bauakustik report 1370-001-12 | 2013-09-11 |

