




SOUND ABSORPTION AREA FOR OBJECT

Measured and evaluated according to ISO 354 and ISO 20189

Client:	Abstracta		
Object:	Bits Wall 30 pcs		
Size [mm]:	w = 2320	h = 3060	d = 95

Octave band (Hz)	Equivalent sound absorption area / unit (m ² Sabine)
63	0
125	1.1
250	2.7
500	4
1000	4.2
2000	4.2
4000	4
N₁₀ = 2.5	

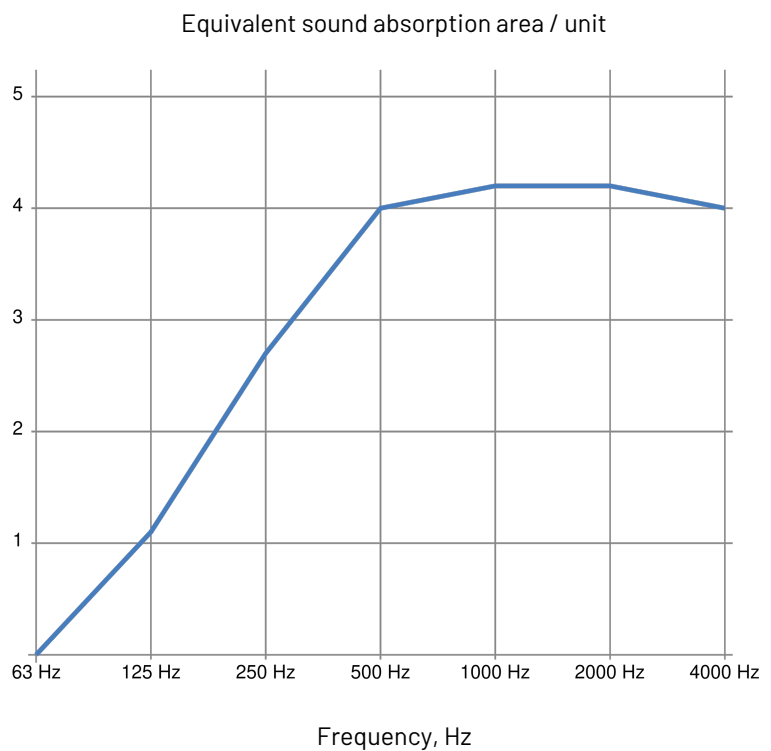

ORIGINAL TEST REPORT	DATE OF TEST
SG-Bauakustik report 1370-001-12	2013-09-11

