




SOUND ABSORPTION AREA FOR OBJECT

Measured and evaluated according to ISO 354 and ISO 20189

| | | | |
|-------------------|---------------|----------|--------|
| Client: | Kinnarps | | |
| Object: | Oktav 96 6pcs | | |
| Size [mm]: | w = 1650 | h = 1100 | d = 96 |

| Octave band (Hz) | Equivalent sound absorption area / unit (m ² Sabine) |
|-----------------------------|---|
| 63 | 0.1 |
| 125 | 0.4 |
| 250 | 1.1 |
| 500 | 1.8 |
| 1000 | 2 |
| 2000 | 1.9 |
| 4000 | 1.9 |
| N₁₀ = 5.6 | |

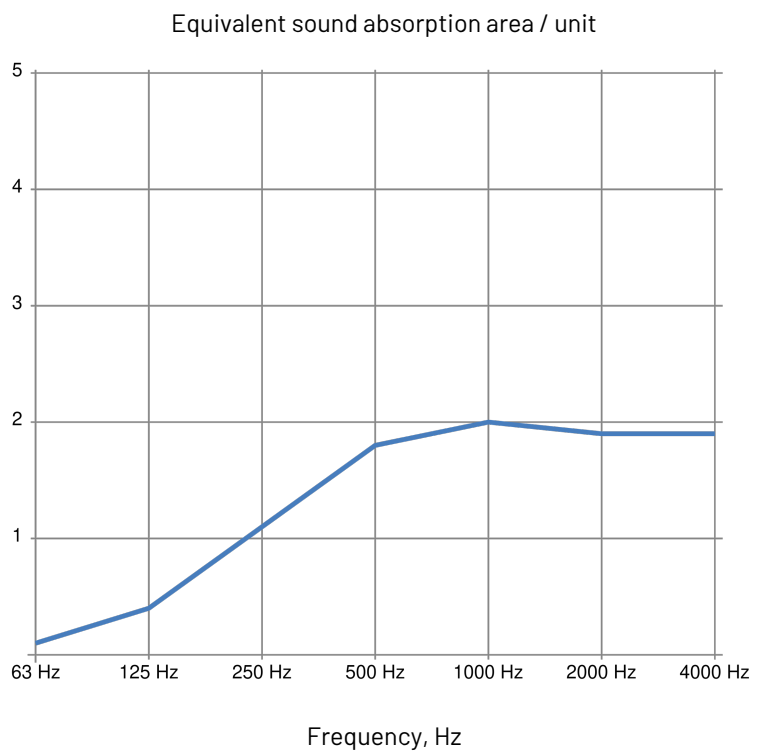

| | |
|-----------------------------|---------------------|
| ORIGINAL TEST REPORT | DATE OF TEST |
| SP report PX18419 | 2012-01-12 |

