




SOUND ABSORPTION AREA FOR OBJECT

Measured and evaluated according to ISO 354 and ISO 20189

| | | | |
|-------------------|-------------------------|----------|--------|
| Client: | OFFECCT | | |
| Object: | Soundwave® Swell 6 pcs. | | |
| Size [mm]: | w = 1755 | h = 1170 | d = 80 |

| Octave band (Hz) | Equivalent sound absorption area / unit (m ² Sabine) |
|-----------------------------|---|
| 63 | 0.1 |
| 125 | 0.2 |
| 250 | 0.8 |
| 500 | 1.5 |
| 1000 | 2 |
| 2000 | 2.1 |
| 4000 | 2 |
| N₁₀ = 6.7 | |

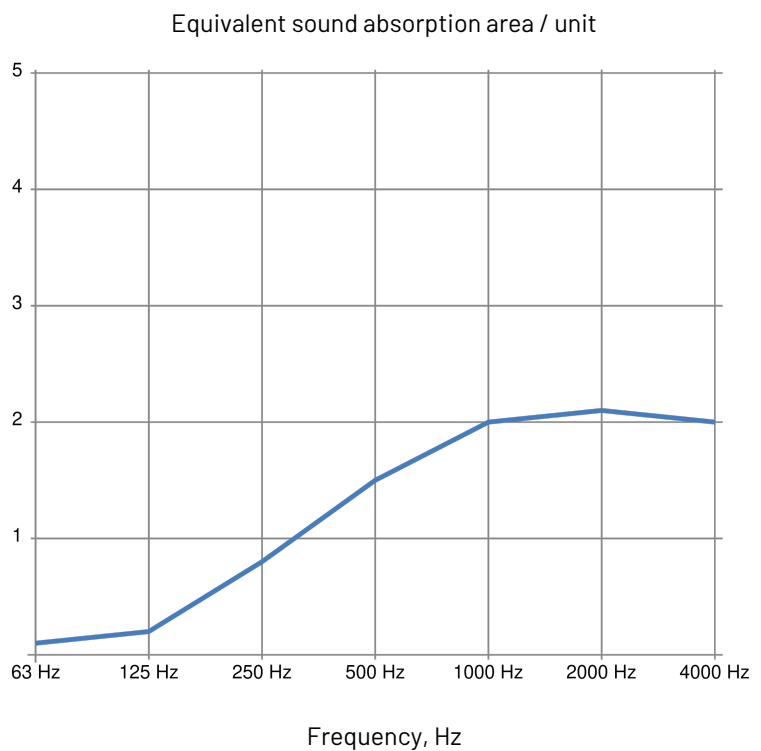

| | |
|---------------------------------|---------------------|
| ORIGINAL TEST REPORT | DATE OF TEST |
| Akustikverkstan report 13-99-R1 | 2013-09-03 |

