




# SOUND ABSORPTION AREA FOR OBJECT

Measured and evaluated according to ISO 354 and ISO 20189

<b>Client:</b>	Glimakra Of Sweden		
<b>Object:</b>	Contrast Floor Screen		
<b>Size [mm]:</b>	w = 1200	h = 1500	d = 40

Octave band (Hz)	Equivalent sound absorption area / unit (m <sup>2</sup> Sabine)
63	0
125	0.2
250	0.6
500	1.4
1000	2.6
2000	3.1
4000	2.8
<b>N<sub>10</sub> = 7.1</b>	

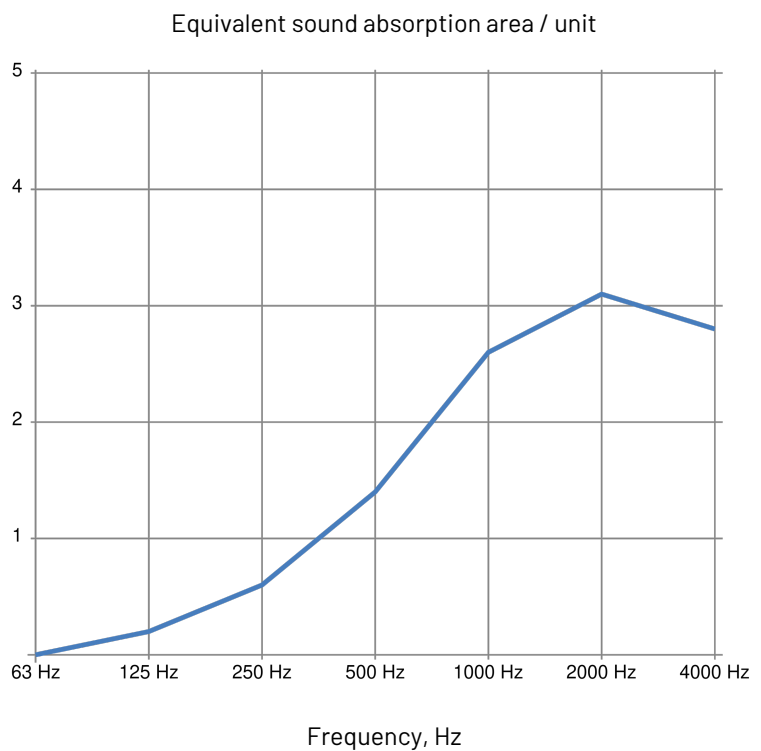

<b>ORIGINAL TEST REPORT</b>	<b>DATE OF TEST</b>
WSP Acoustics report 10171560.03	2012-01-30

