




# SOUND ABSORPTION AREA FOR OBJECT

Measured and evaluated according to ISO 354 and ISO 20189

<b>Client:</b>	Götessons/ Gotessons, Akustikmiljö / Am Acoustics		
<b>Object:</b>	Effekt		
<b>Size [mm]:</b>	w = 1200	h = 300	d = 50

Octave band (Hz)	Equivalent sound absorption area / unit (m <sup>2</sup> Sabine)
63	0.1
125	0.2
250	0.5
500	0.7
1000	0.8
2000	0.8
4000	0.8
<b>N<sub>10</sub> = 14.3</b>	

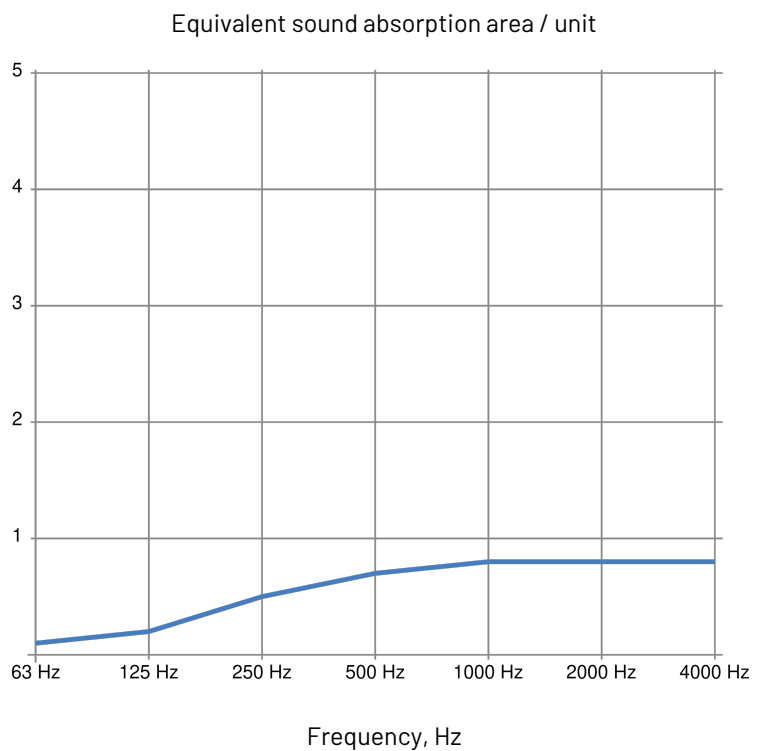

<b>ORIGINAL TEST REPORT</b>	<b>DATE OF REPORT</b>
Akustikverkstan report 16-239-M10	2017-03-09

