




# SOUND ABSORPTION AREA FOR OBJECT

Measured and evaluated according to ISO 354 and ISO 20189

<b>Client:</b>	Götessons/ Gotessons, Akustikmiljö / Am Acoustics		
<b>Object:</b>	Lod		
<b>Size [mm]:</b>	w = 3000	h = 2400	d = 50

Octave band (Hz)	Equivalent sound absorption area / unit (m <sup>2</sup> Sabine)
63	0.4
125	1
250	2.4
500	4.1
1000	4.8
2000	4.6
4000	5.3
<b>N<sub>10</sub> = 2.4</b>	

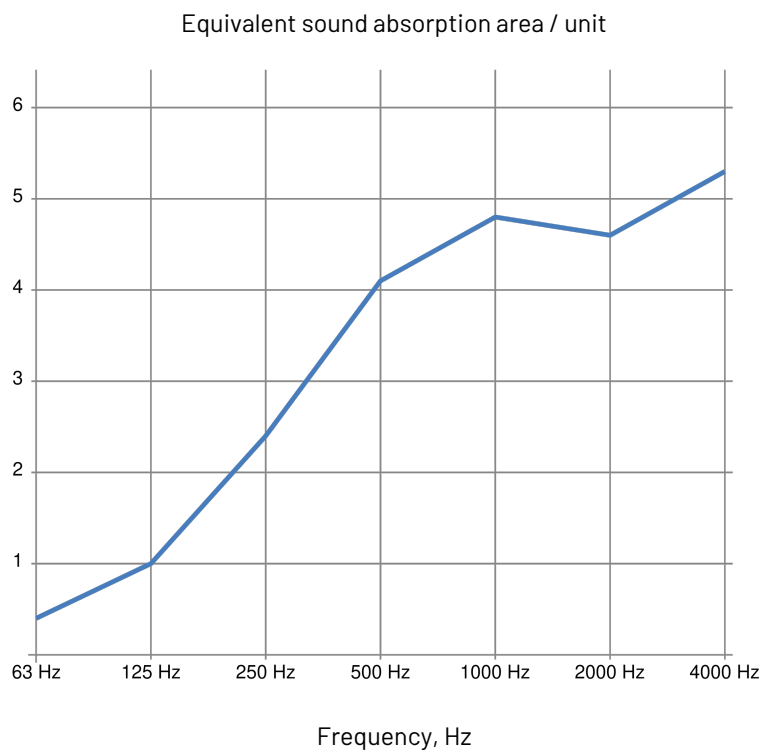

<b>ORIGINAL TEST REPORT</b>	<b>DATE OF REPORT</b>
Akustikverkstan report 16-239-M23	2017-03-09

