




# SOUND ABSORPTION AREA FOR OBJECT

Measured and evaluated according to ISO 354 and ISO 20189

<b>Client:</b>	Abstracta		
<b>Object:</b>	Softline 30 Floor Screen		
<b>Size [mm]:</b>	w = 1000	h = 1500	d = 30

Octave band (Hz)	Equivalent sound absorption area / unit (m <sup>2</sup> Sabine)
63	0.3
125	0.6
250	1
500	1.5
1000	2.1
2000	2.4
4000	2.5
<b>N<sub>10</sub> = 6.7</b>	

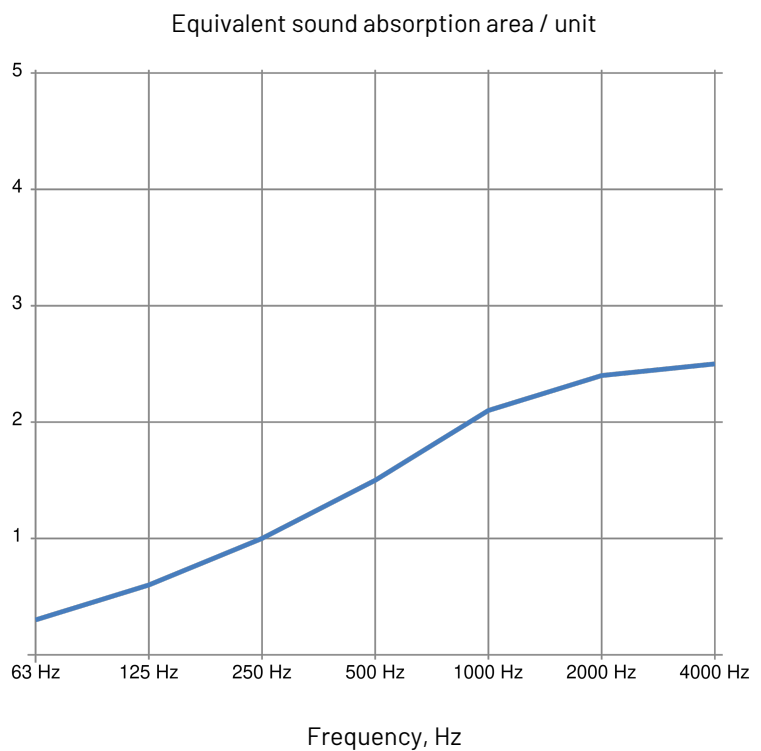

<b>ORIGINAL TEST REPORT</b>	<b>DATE OF REPORT</b>
Akustikverkstan report 15-240-M6	2016-01-29

