




SOUND ABSORPTION AREA FOR OBJECT

Measured and evaluated according to ISO 354 and ISO 20189

Client:	Abstracta		
Object:	Softline 30 Floor Screen		
Size [mm]:	w = 1000	h = 1500	d = 30

Octave band (Hz)	Equivalent sound absorption area / unit (m ² Sabine)
63	0.3
125	0.6
250	1
500	1.5
1000	2.1
2000	2.4
4000	2.5
N₁₀ = 6.7	

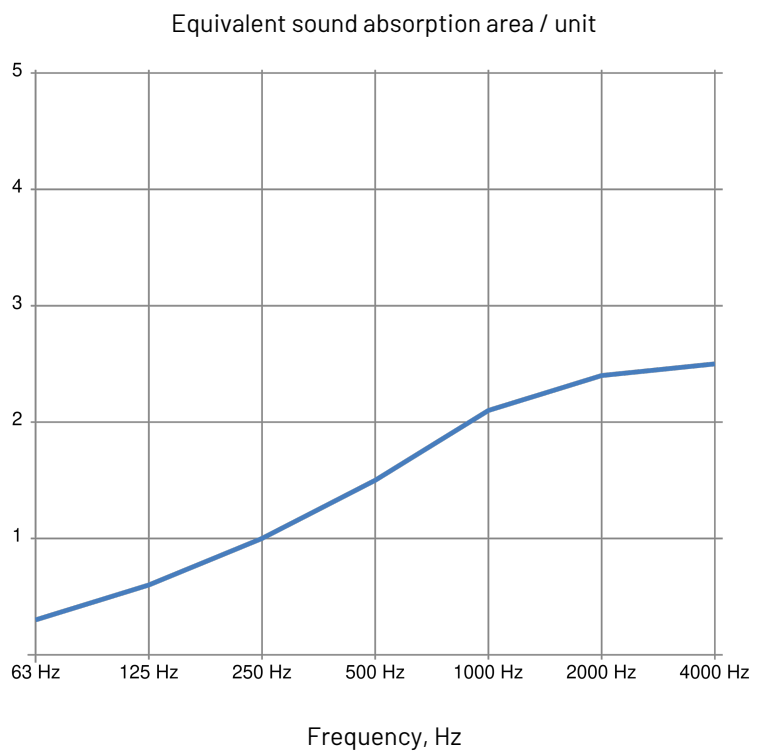

ORIGINAL TEST REPORT	DATE OF REPORT
Akustikverkstan report 15-240-M6	2016-01-29

