




# SOUND ABSORPTION AREA FOR OBJECT

Measured and evaluated according to ISO 354 and ISO 20189

<b>Client:</b>	Abstracta		
<b>Object:</b>	Softline 30 Floor Screen		
<b>Size [mm]:</b>	w = 1200	h = 1500	d = 30

Octave band (Hz)	Equivalent sound absorption area / unit (m <sup>2</sup> Sabine)
63	0.4
125	0.6
250	1.2
500	1.9
1000	2.5
2000	2.6
4000	2.7
<b>N<sub>10</sub> = 5.3</b>	

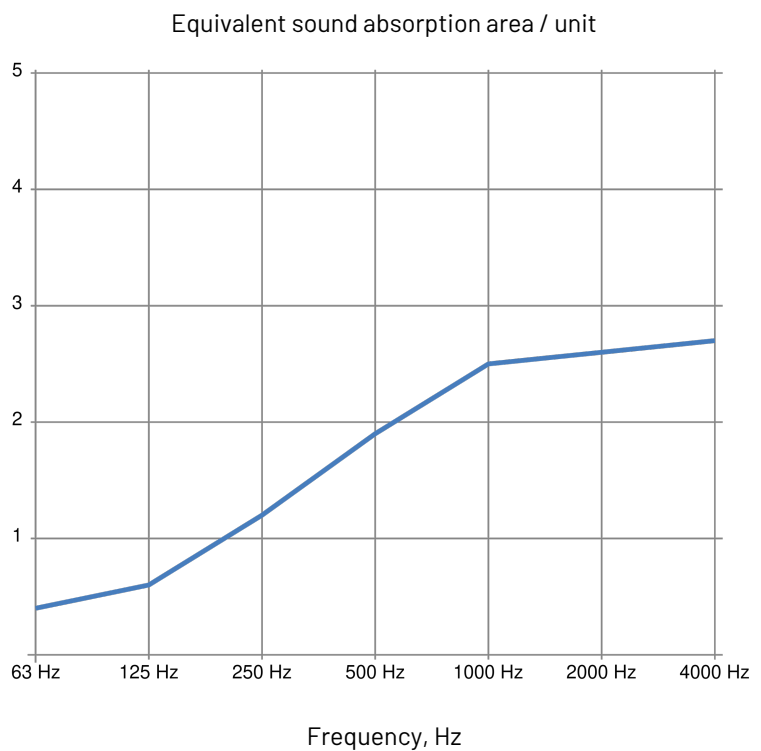

<b>ORIGINAL TEST REPORT</b>	<b>DATE OF REPORT</b>
Akustikverkstan report 15-240-M5	2016-01-29

