




SOUND ABSORPTION AREA FOR OBJECT

Measured and evaluated according to ISO 354 and ISO 20189

Client:	Abstracta		
Object:	Scala Floor		
Size [mm]:	w = 1207	h = 1600	d = 60

Octave band (Hz)	Equivalent sound absorption area / unit (m ² Sabine)
63	0.3
125	0.5
250	1.4
500	2.1
1000	2.9
2000	3.4
4000	3.8
N₁₀ = 4.8	

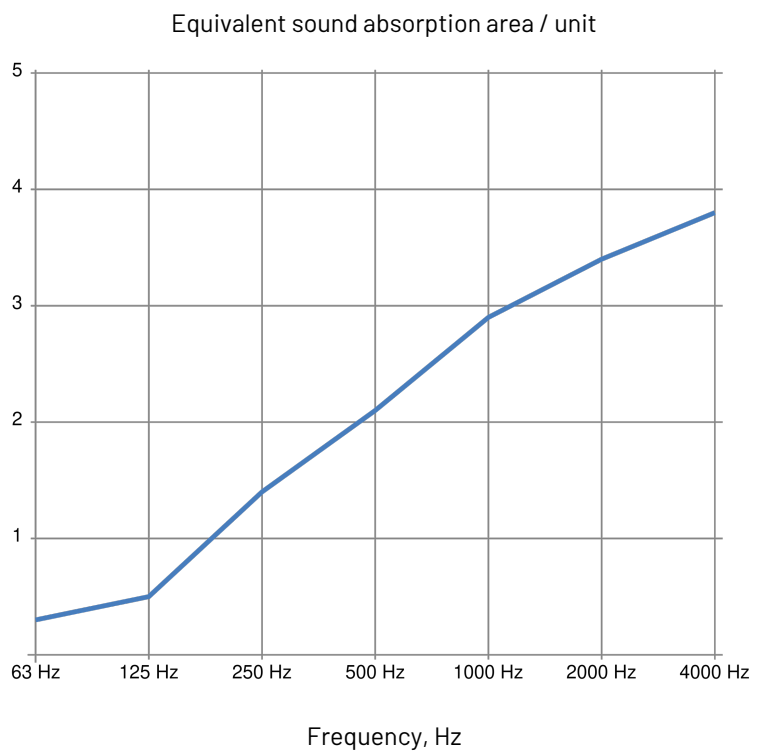

ORIGINAL TEST REPORT	DATE OF REPORT
Akustikverkstan 17-094-M8	2017-05-19

