




# SOUND ABSORPTION AREA FOR OBJECT

Measured and evaluated according to ISO 354 and ISO 20189

<b>Client:</b>	Abstracta		
<b>Object:</b>	Scala Floor		
<b>Size [mm]:</b>	w = 1207	h = 1600	d = 60

Octave band (Hz)	Equivalent sound absorption area / unit (m <sup>2</sup> Sabine)
63	0.3
125	0.5
250	1.4
500	2.1
1000	2.9
2000	3.4
4000	3.8
<b>N<sub>10</sub> = 4.8</b>	

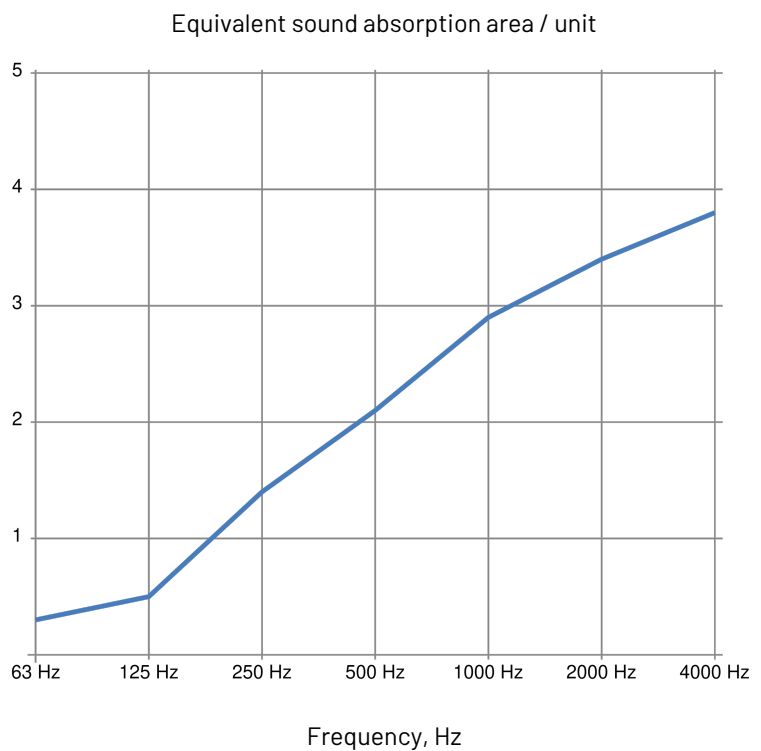

<b>ORIGINAL TEST REPORT</b>	<b>DATE OF REPORT</b>
Akustikverkstan 17-094-M8	2017-05-19

