




SOUND ABSORPTION AREA FOR OBJECT

Measured and evaluated according to ISO 354 and ISO 20189

Client:	Abstracta		
Object:	dB Floor Screen		
Size [mm]:	w = 1600	h = 1500	d = 30

Octave band (Hz)	Equivalent sound absorption area / unit (m ² Sabine)
63	0.4
125	0.6
250	1.6
500	2.4
1000	3
2000	3
4000	2.8
N₁₀ = 4.2	

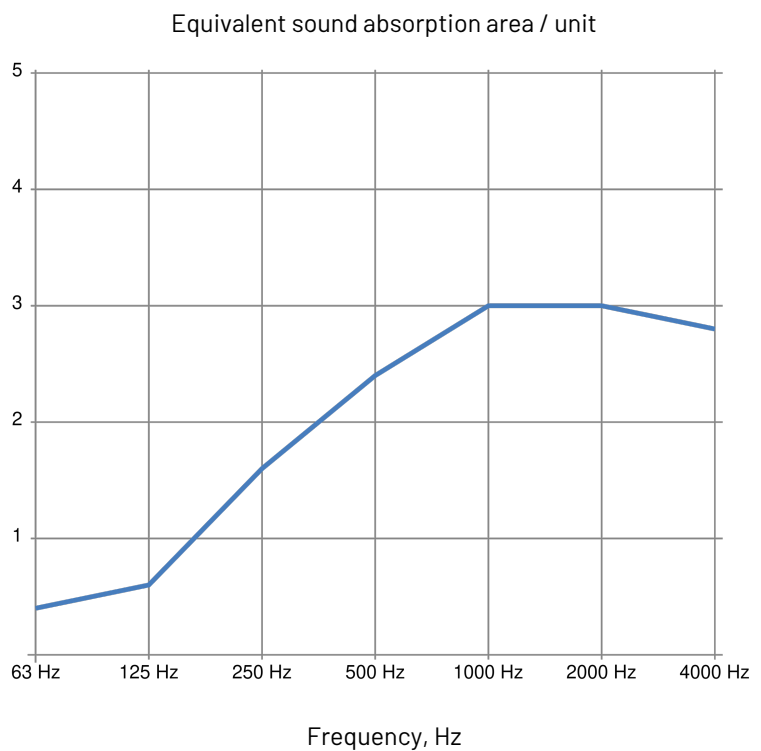

ORIGINAL TEST REPORT	DATE OF REPORT
Akustikverkstan 17-360-M2	2018-01-23

