




SOUND ABSORPTION AREA FOR OBJECT

Measured and evaluated according to ISO 354 and ISO 20189

| | | | |
|-------------------|-----------------|----------|--------|
| Client: | Abstracta | | |
| Object: | Airbloom 10 pcs | | |
| Size [mm]: | w = 912 | h = 2325 | d = 50 |

| Octave band (Hz) | Equivalent sound absorption area / unit (m ² Sabine) |
|------------------------------|---|
| 63 | 0 |
| 125 | 0.05 |
| 250 | 0.15 |
| 500 | 0.3 |
| 1000 | 0.5 |
| 2000 | 0.6 |
| 4000 | 0.7 |
| N₁₀ = 33.3 | |

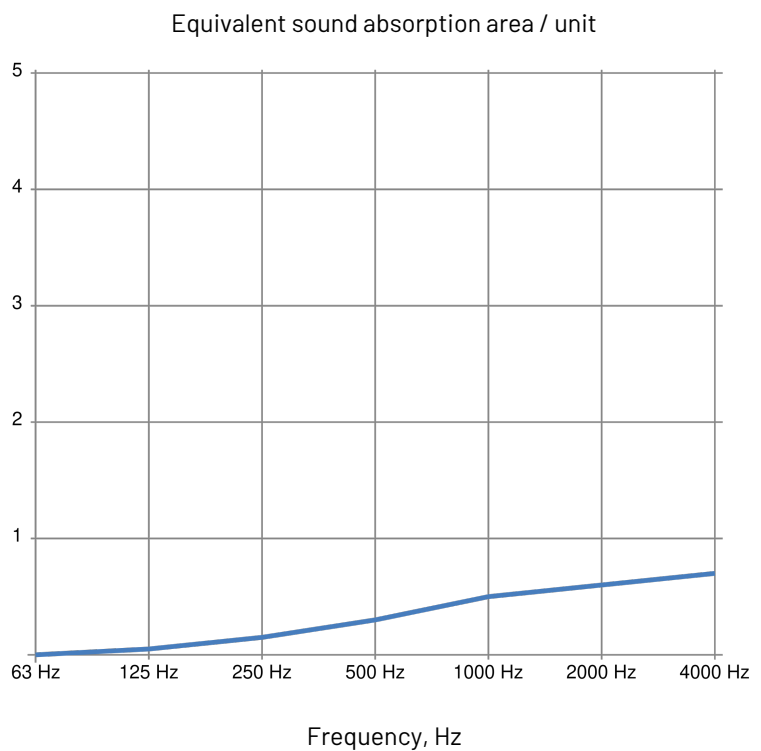

| | |
|-----------------------------------|-----------------------|
| ORIGINAL TEST REPORT | DATE OF REPORT |
| Akustikverkstan report 17-094-M12 | 2017-05-10 |

