




# SOUND ABSORPTION AREA FOR OBJECT

Measured and evaluated according to ISO 354 and ISO 20189

<b>Client:</b>	Abstracta		
<b>Object:</b>	Airbloom 10 pcs		
<b>Size [mm]:</b>	w = 912	h = 2325	d = 50

Octave band (Hz)	Equivalent sound absorption area / unit (m <sup>2</sup> Sabine)
63	0
125	0.05
250	0.15
500	0.3
1000	0.5
2000	0.6
4000	0.7
<b>N<sub>10</sub> = 33.3</b>	

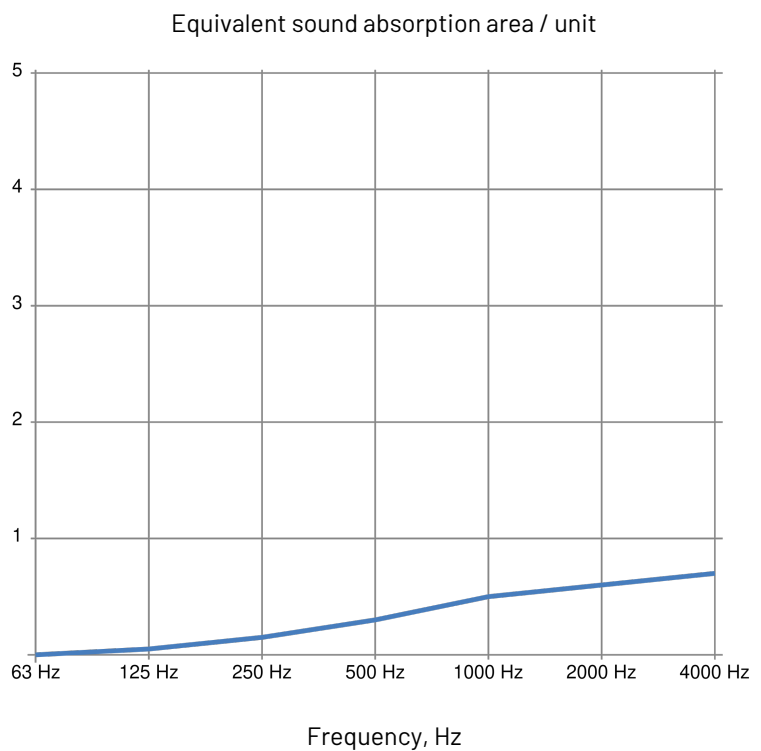

<b>ORIGINAL TEST REPORT</b>	<b>DATE OF REPORT</b>
Akustikverkstan report 17-094-M12	2017-05-10

