




SOUND ABSORPTION AREA FOR OBJECT

Measured and evaluated according to ISO 354 and ISO 20189

Client:	Abstracta		
Object:	My Hive		
Size [mm]:	w = 1000	h = 1300	d = 3000

Octave band (Hz)	Equivalent sound absorption area / unit (m ² Sabine)
63	
125	2.31
250	3.29
500	4.47
1000	5.13
2000	5.27
4000	5.4
N₁₀ = 2.2	

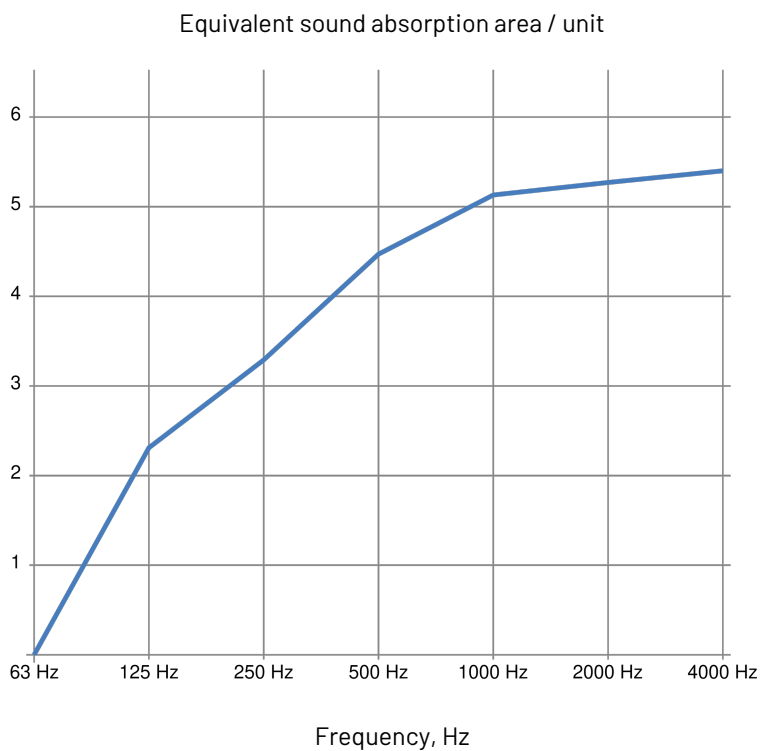

ORIGINAL TEST REPORT	DATE OF REPORT
KTH-MWL LW20160923_0003	2016-09-23

