




SOUND ABSORPTION AREA FOR OBJECT

Measured and evaluated according to ISO 354 and ISO 20189

Client:	Abstracta		
Object:	Bits Wall		
Size [mm]:	w = 510	h = 580	d = 95

Octave band (Hz)	Equivalent sound absorption area / unit (m ² Sabine)
63	0
125	0.04
250	0.09
500	0.13
1000	0.14
2000	0.14
4000	0.13
N₁₀ = 76.9	

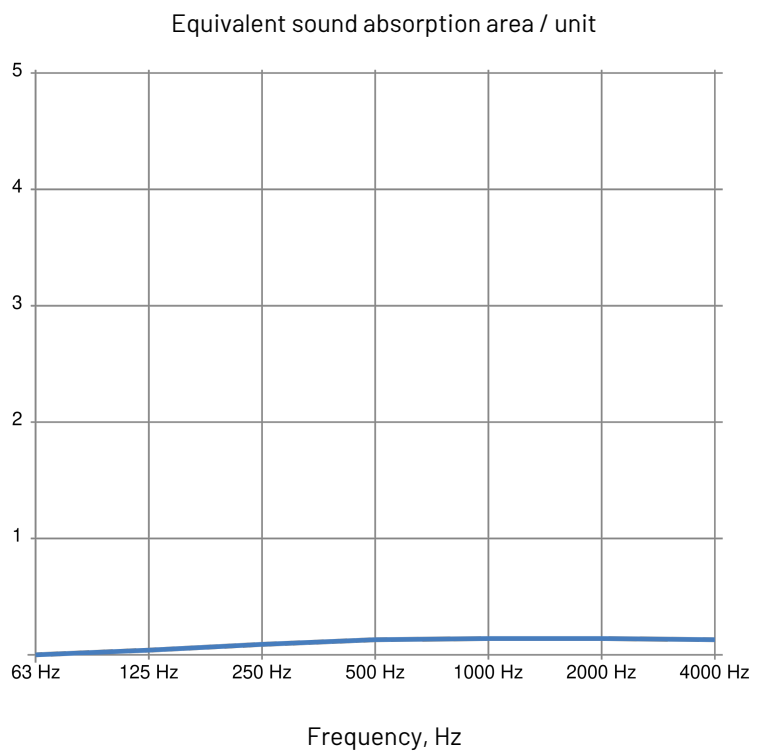

ORIGINAL TEST REPORT	DATE OF REPORT
SG-Bauakustik report SG 1370-001-12	2012-02-16

