




SOUND ABSORPTION AREA FOR OBJECT

Measured and evaluated according to ISO 354 and ISO 20189

Client:	Abstracta		
Object:	Soneo Wall		
Size [mm]:	w = 1000	h = 1000	d = 50

Octave band (Hz)	Equivalent sound absorption area / unit (m ² Sabine)
63	0.1
125	0.3
250	0.45
500	0.7
1000	0.8
2000	0.85
4000	0.8
N₁₀ = 14.3	

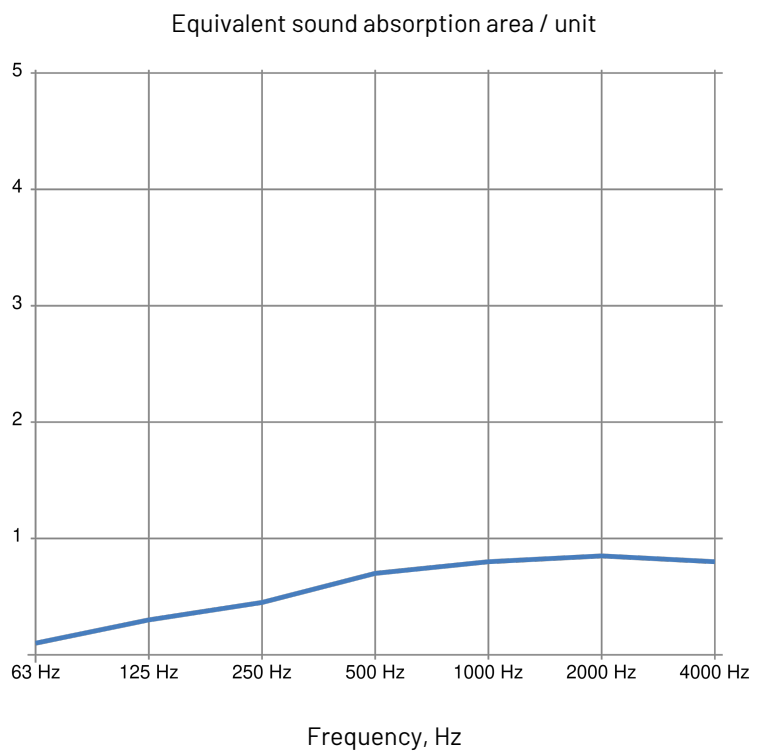

ORIGINAL TEST REPORT	DATE OF REPORT
SP report PX04109B	2010-08-02

