




SOUND ABSORPTION AREA FOR OBJECT

Measured and evaluated according to ISO 354 and ISO 20189

Client:	Abstracta		
Object:	Softline 50 Floor Screen		
Size [mm]:	w = 800	h = 1360	d = 50

Octave band (Hz)	Equivalent sound absorption area / unit (m ² Sabine)
63	0.2
125	0.3
250	0.9
500	1.5
1000	1.8
2000	1.8
4000	1.9
N₁₀ = 6.7	

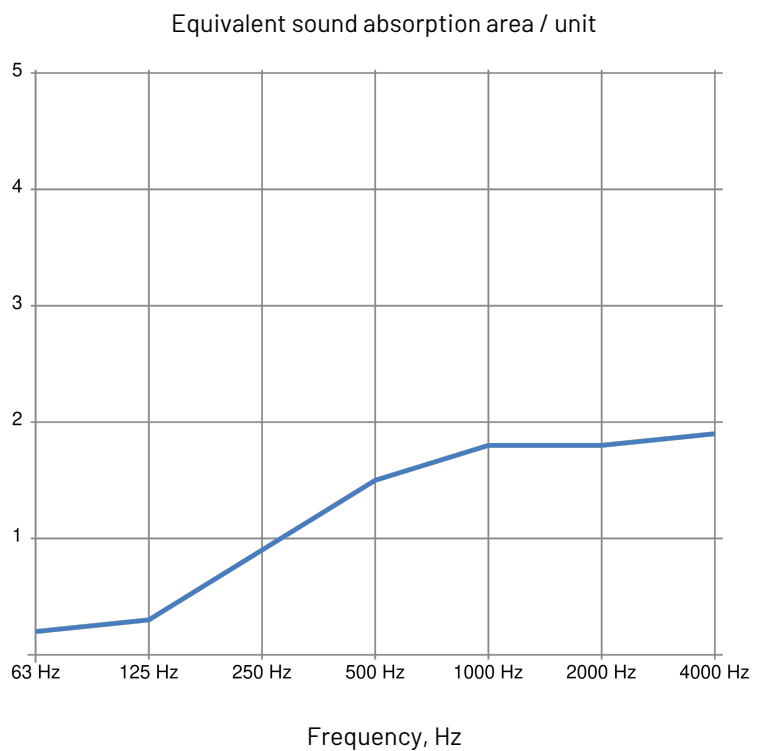

ORIGINAL TEST REPORT	DATE OF REPORT
Akustikverkstan report 18-720-R2-M13	2018-12-13

