




SOUND ABSORPTION AREA FOR OBJECT

Measured and evaluated according to ISO 354 and ISO 20189

Client:	Abstracta		
Object:	Softline 50 Floor Screen		
Size [mm]:	w = 1200	h = 1500	d = 50

Octave band (Hz)	Equivalent sound absorption area / unit (m ² Sabine)
63	0.4
125	0.6
250	1.5
500	2.4
1000	3
2000	3.1
4000	3.2
N₁₀ = 4.2	

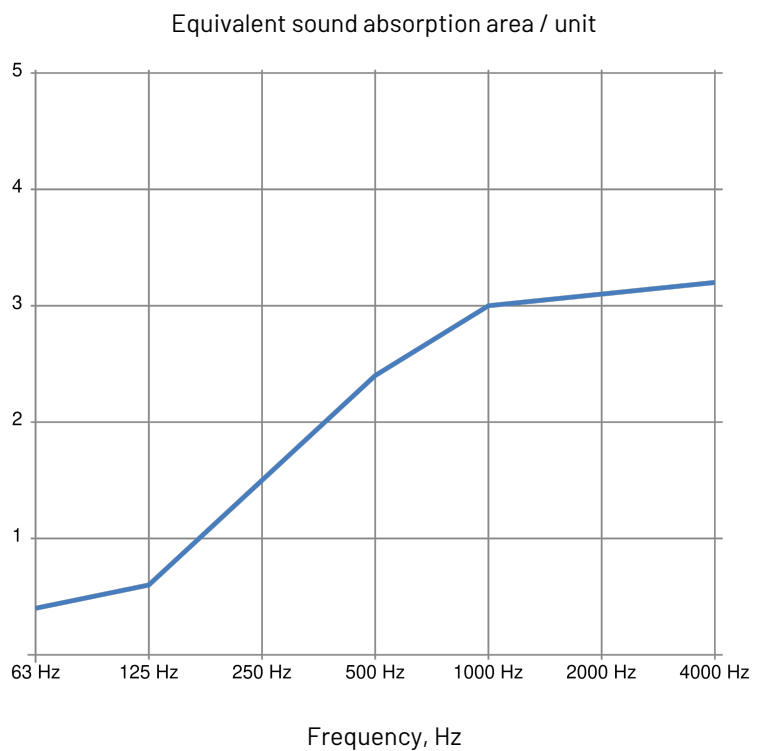

ORIGINAL TEST REPORT	DATE OF REPORT
Akustikverkstan report 18-720-R2-M15	2018-12-13

