




# SOUND ABSORPTION AREA FOR OBJECT

Measured and evaluated according to ISO 354 and ISO 20189

|                   |                          |          |        |
|-------------------|--------------------------|----------|--------|
| <b>Client:</b>    | Abstracta                |          |        |
| <b>Object:</b>    | Softline 50 Floor Screen |          |        |
| <b>Size [mm]:</b> | w = 1200                 | h = 1700 | d = 50 |

| Octave band (Hz)            | Equivalent sound absorption area / unit (m <sup>2</sup> Sabine) |
|-----------------------------|---|
| 63                          | 0.5   |
| 125                         | 0.6   |
| 250                         | 1.7   |
| 500                         | 2.9   |
| 1000                        | 3.5   |
| 2000                        | 3.4   |
| 4000                        | 3.7   |
| <b>N<sub>10</sub> = 3.4</b> |   |

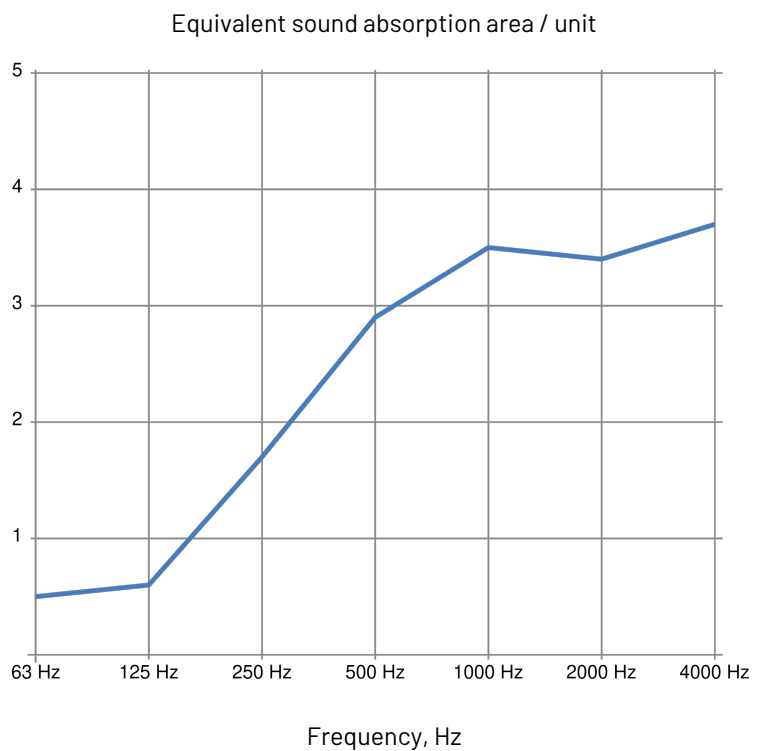

|                                      |                       |
|--------------------------------------|-----------------------|
| <b>ORIGINAL TEST REPORT</b>          | <b>DATE OF REPORT</b> |
| Akustikverkstan report 18-720-R2-M16 | 2018-12-13            |

