




SOUND ABSORPTION AREA FOR OBJECT

Measured and evaluated according to ISO 354 and ISO 20189

Client:	Abstracta		
Object:	Softline 50 Floor Screen		
Size [mm]:	w = 800	h = 1500	d = 50

Octave band (Hz)	Equivalent sound absorption area / unit (m ² Sabine)
63	0.2
125	0.3
250	1
500	1.7
1000	2
2000	2
4000	2
N₁₀ = 5.9	

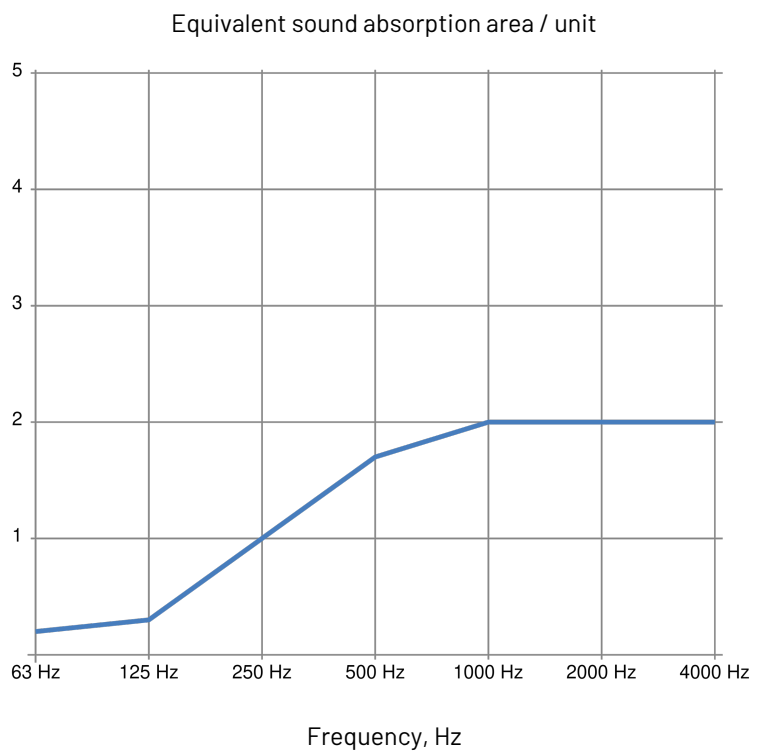

ORIGINAL TEST REPORT	DATE OF REPORT
Akustikverkstan report 18-720-R2-M17	2018-12-13

