




# SOUND ABSORPTION AREA FOR OBJECT

Measured and evaluated according to ISO 354 and ISO 20189

<b>Client:</b>	Abstracta		
<b>Object:</b>	Softline 50 Floor Screen		
<b>Size [mm]:</b>	w = 1000	h = 1360	d = 50

Octave band (Hz)	Equivalent sound absorption area / unit (m <sup>2</sup> Sabine)
63	0.3
125	0.4
250	1.1
500	1.9
1000	2.2
2000	2.2
4000	2.3
<b>N<sub>10</sub> = 5.3</b>	

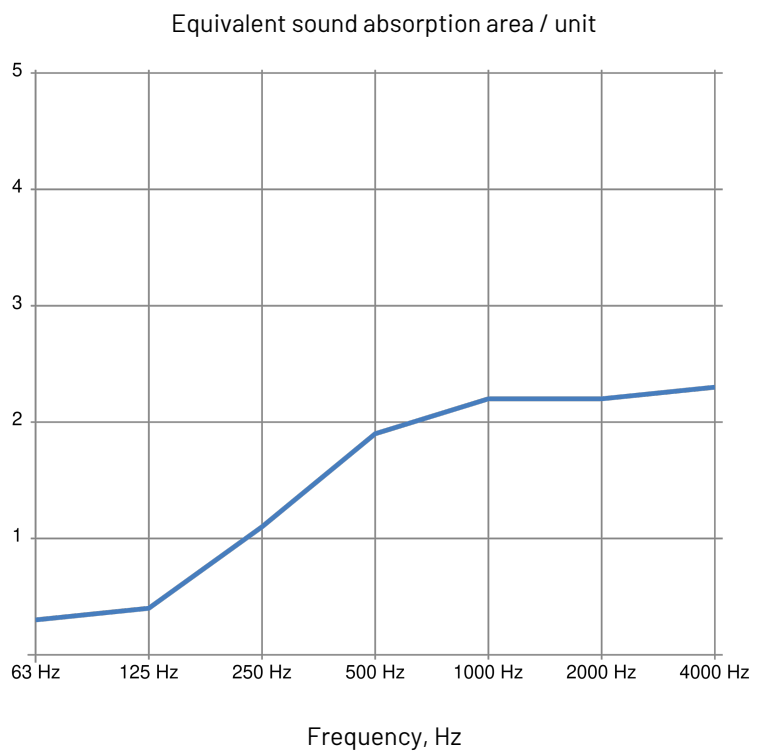

<b>ORIGINAL TEST REPORT</b>	<b>DATE OF REPORT</b>
Akustikverkstan report 18-720-R2-M19	2018-12-13

