




SOUND ABSORPTION AREA FOR OBJECT

Measured and evaluated according to ISO 354 and ISO 20189

| | | | |
|-------------------|--------------------------|----------|--------|
| Client: | Abstracta | | |
| Object: | Softline 50 Floor Screen | | |
| Size [mm]: | w = 1000 | h = 1360 | d = 50 |

| Octave band (Hz) | Equivalent sound absorption area / unit (m ² Sabine) |
|-----------------------------|---|
| 63 | 0.3 |
| 125 | 0.4 |
| 250 | 1.1 |
| 500 | 1.9 |
| 1000 | 2.2 |
| 2000 | 2.2 |
| 4000 | 2.3 |
| N₁₀ = 5.3 | |

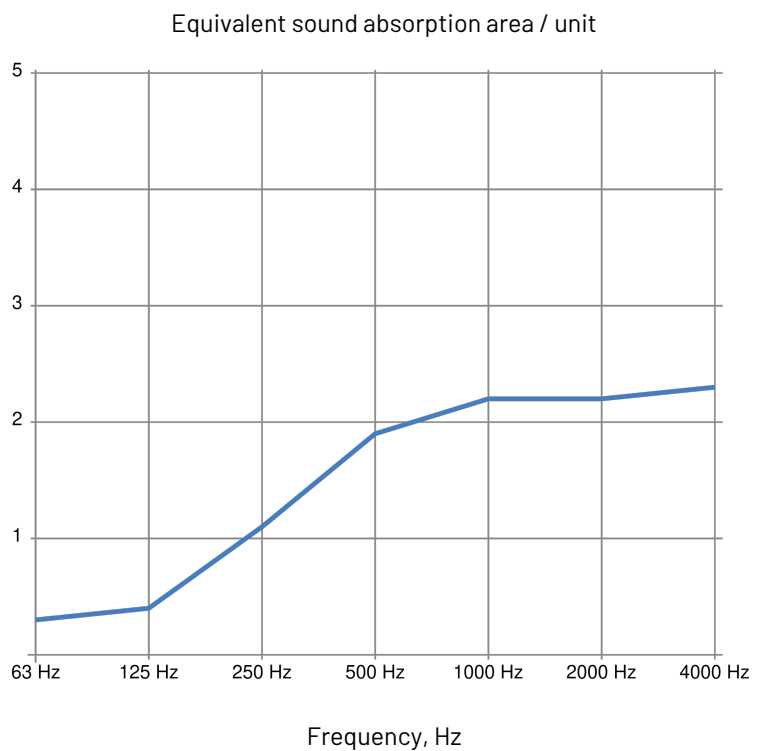

| | |
|--------------------------------------|-----------------------|
| ORIGINAL TEST REPORT | DATE OF REPORT |
| Akustikverkstan report 18-720-R2-M19 | 2018-12-13 |

