




SOUND ABSORPTION AREA FOR OBJECT

Measured and evaluated according to ISO 354 and ISO 20189

Client:	Abstracta		
Object:	Softline 50 Floor Screen		
Size [mm]:	w = 1200	h = 1360	d = 50

Octave band (Hz)	Equivalent sound absorption area / unit (m ² Sabine)
63	0.3
125	0.5
250	1.3
500	2.2
1000	2.7
2000	2.7
4000	2.8
N₁₀ = 4.5	

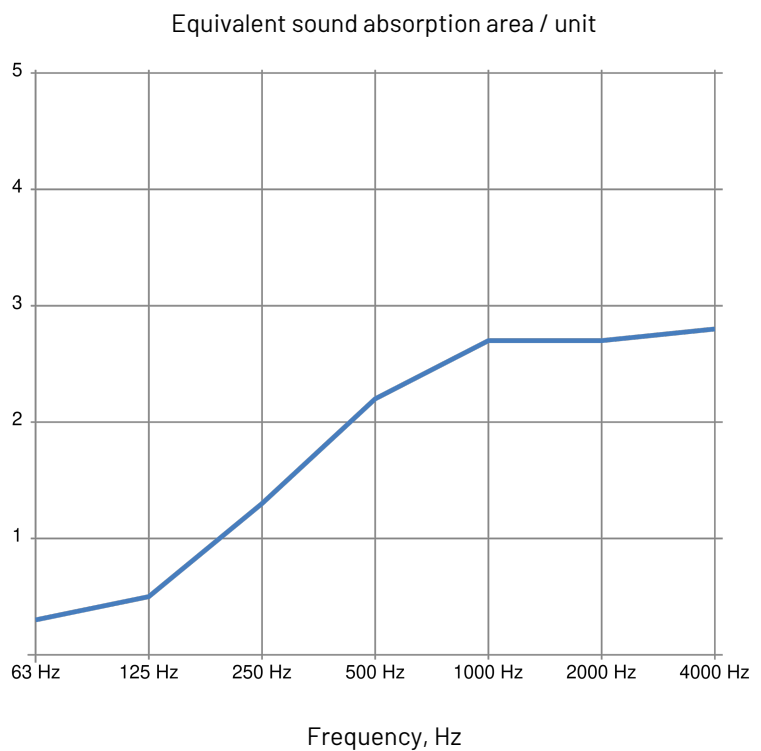

ORIGINAL TEST REPORT	DATE OF REPORT
Akustikverkstan report 18-720-R2-M21	2018-12-13

