




# SOUND ABSORPTION COEFFICIENT

Measured and evaluated according to ISO 354 and ISO 11654

Client: Blå Station

Surface: Arc

Octave band (Hz)	Sound absorption coefficient (-)
63	0.05
125	0.1
250	0.5
500	0.6
1000	0.6
2000	0.55
4000	0.6
$\alpha_w$	0.60
NRC	0.55

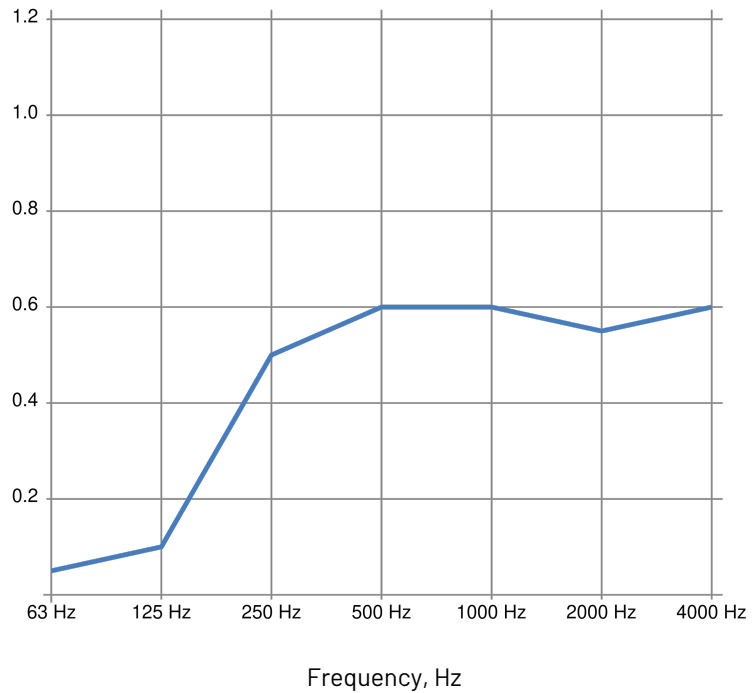

ORIGINAL TEST REPORT

19-721-M1

DATE OF REPORT

2019-09-09

