




# SOUND ABSORPTION AREA FOR OBJECT

Measured and evaluated according to ISO 354 and ISO 20189

<b>Client:</b>	Götessons/ Gotessons		
<b>Object:</b>	Sound Off Ceiling		
<b>Size [mm]:</b>	w = 1400	h = 1400	d = 50

Octave band (Hz)	Equivalent sound absorption area / unit (m <sup>2</sup> Sabine)
63	0.4
125	0.8
250	1.1
500	1.7
1000	2.1
2000	2.3
4000	2.7
<b>N<sub>10</sub> = 5.9</b>	

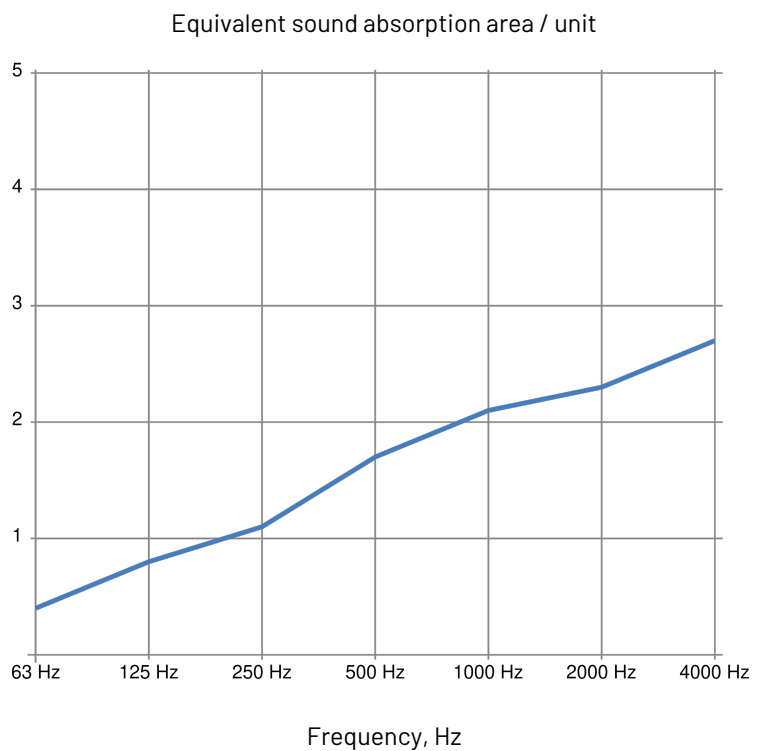

<b>ORIGINAL TEST REPORT</b>	<b>DATE OF TEST</b>
Akustikverkstan report 16-239-M19	2017-01-16

