




SOUND ABSORPTION AREA FOR OBJECT

Measured and evaluated according to ISO 354 and ISO 20189

Client:	Götessons/ Gotessons		
Object:	ScreenIT Standard		
Size [mm]:	w = 1600	h = 650	d = 20

Octave band (Hz)	Equivalent sound absorption area / unit (m ² Sabine)
63	0.07
125	0.1
250	0.2
500	0.27
1000	0.5
2000	0.83
4000	1.4
N ₁₀ = 37	

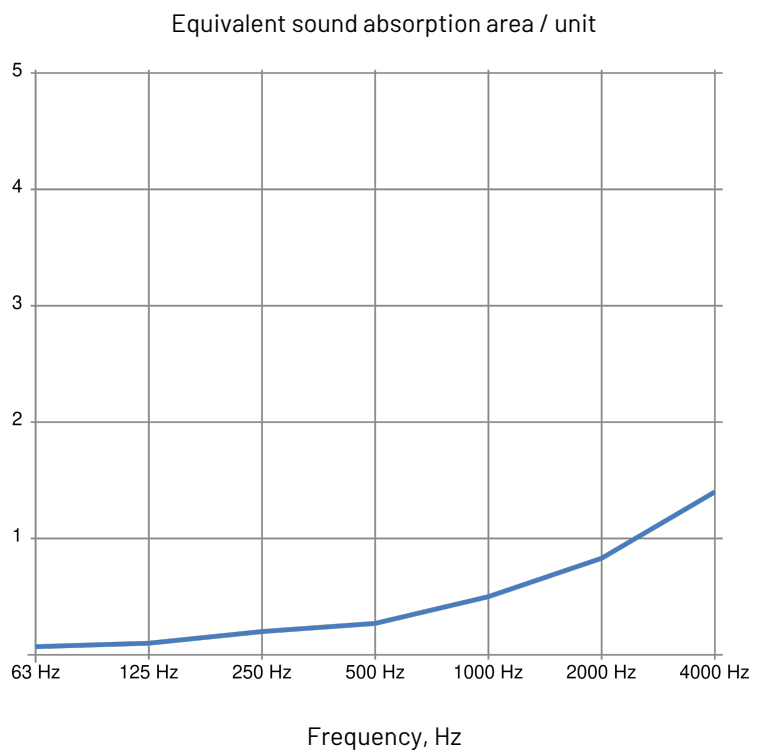

ORIGINAL TEST REPORT	DATE OF TEST
SP report 4P03825 /Annex 8	2014-06-08

