


**SOUND ABSORPTION MEASURED AND EVALUATED  
ACCORDING TO ISO 354 AND SS-EN ISO 11654**

CLIENT: Abstracta AB

OBJECT: Abstracta Triline Wall, 800×400 mm<sup>2</sup>, total area tested 11.52 m<sup>2</sup> (36 one-sided wall panels)

1/3 octave band (Hz)	Equivalent sound absorption area / object (m <sup>2</sup> Sabine)	
	1/3 octave band	Octave band
50	0,02	
63	0,04	-
80	0,06	
100	0,06	
125	0,11	0,1
160	0,13	
200	0,17	
250	0,20	0,2
315	0,24	
400	0,30	
500	0,32	0,3
630	0,33	
800	0,34	
1000	0,35	0,3
1250	0,34	
1600	0,31	
2000	0,33	0,3
2500	0,30	
3150	0,32	
4000	0,30	0,3
5000	0,29	

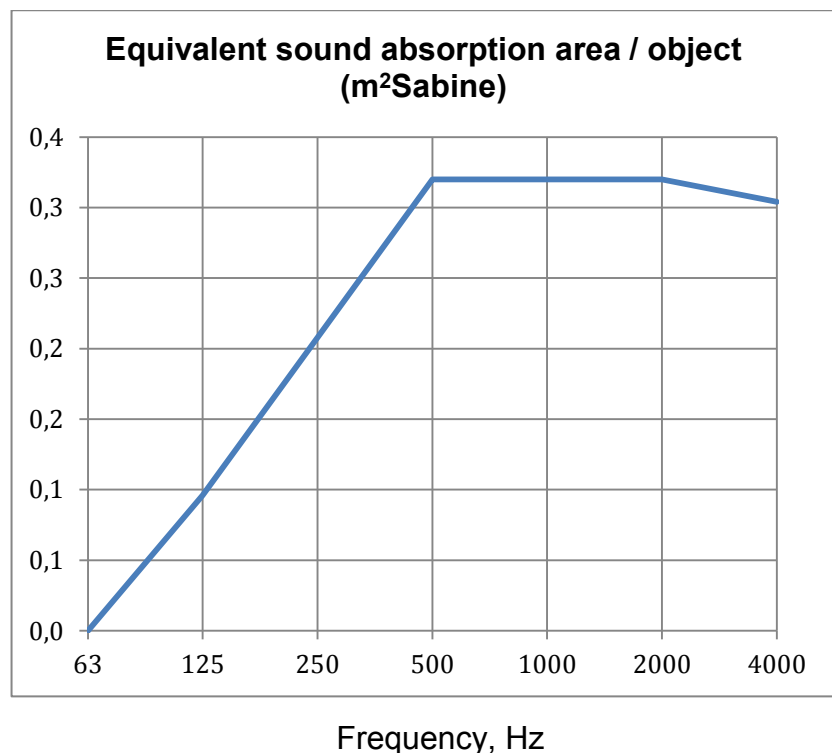

**CONDITIONS**

Date of test: 2011-09-09  
Date: 2013-06-05

Object surface: 0.32 m<sup>2</sup>  
Reverberation room volume: 161 m<sup>3</sup>

Relative humidity: 59%  
Temperature: 21°C

Test report: 1338-001-11 (SG-Bauakustik, Germany)  
Signature: Stefan Grüll